



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

Aldora Aluminum & Glass Products, Inc.

11500 Miramar Parkway, Suite 300

Miramar, FL 33025

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "K2LM" 10'-0" Outswing Glazed Aluminum Entrance Door w/wo Transom- L.M.I.

APPROVAL DOCUMENT: Drawing No. **W04-91**, titled "Series K2LM Alum. Out-Swing Entrance Door", sheets 1 through 4, 4.1, 4.2, 5 through 8, 8.1, 9, 9.1, 10, 11 and 11.1 of 11, dated 10/25/04, with revision "J" dated 01/05/18, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **MIRAMAR, FL, POMPAÑO BEACH, FL, ORLANDO, FL, CHARLESTON, SC and CHARLOTTE, NC**, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises** **NOA No. 17-0125.02** and consists of this page 1 and evidence pages E-1, E-2, E-3, E-4 and E-5, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jorge M. Plasencia, P. E.**



[Signature] 1/19/2018

NOA No. 17-1106.01

Expiration Date: May 12, 2022

Approval Date: January 25, 2018

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA'S

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 05-0301.04 and current NOA)
2. Drawing No. **W04-91**, titled "Series K2LM Alum. Out-Swing Entrance Door", sheets 1 through 4, 4.1, 4.2, 5 through 8, 8.1, 9, 9.1, 10, 11 and 11.1 of 16, dated 10/25/04, with revision "**H**" dated 01/11/17, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test per FBC, TAS 202-94
2) Uniform Static Air Pressure Test Loading per FBC, TAS 202-94
3) Water Resistance Test per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum outswing door with transom, prepared by Blackwater Testing, Inc., Test Report No. **BT-ALD-15-009**, dated 02/18/16 respectively, signed and sealed by Yamil Gerardo Kuri, P. E.
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum outswing door with transom, prepared by Blackwater Testing, Inc., Test Report No. **BT-ALD-15-008**, dated 02/15/16 respectively, signed and sealed by Yamil Gerardo Kuri, P. E.
3. Test reports on: 1) Air Infiltration Test per FBC, TAS 202-94
2) Uniform Static Air Pressure Test Loading per FBC, TAS 202-94
3) Water Resistance Test per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94
along with marked-up drawings and installation diagram of an aluminum outswing door, all prepared by Fenestration Testing Laboratory, Inc., Test Reports No.'s **FTL-4267, FTL-4238, FTL-4257 and FTL-4276**, dated 06/18/04, 06/30/04, 08/12/04 and 08/13/04 all respectively, signed and sealed by Edmundo J. Largaespada, P. E.
(Submitted under NOA No. 05-0301.04)


Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-1106.01
Expiration Date: May 12, 2022
Approval Date: January 25, 2018

Aldora Aluminum & Glass Products, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 5th Edition (2014)**, prepared by Al-Farooq Corporation, dated 01/17/17, signed and sealed by Javad Ahmad, P. E.
2. **Glazing complies with ASTM E1300-09.**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **15-1201.11** issued to **Eastman Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" dated 05/17/16, expiring on 05/21/21.
2. Notice of Acceptance No. **14-0423.16** issued to **Eastman Chemical Company (MA)** for their "**Saflex HP Clear or Color Glass Interlayers**" dated 06/19/14, expiring on 04/14/18.
3. Notice of Acceptance No. **13-1126. 20** issued to **Allnex USA, Inc.** for their "**Uvekol S Laminated Glass Interlayer**", dated 02/20/14, expiring on 02/08/19.
4. Material Data Sheet for the Neoprene setting block material, by Frank Lowe Rubber & Gasket Co., Inc.

F. STATEMENTS

1. Statement letter of conformance to, of complying with **FBC 5th Edition (2014)**, and of no financial interest, dated 10/10/13 and dated 01/17/17, signed and sealed by Javad Ahmad, P. E.
2. Department of State Certification of **ALDORA ALUMINUM & GLASS PRODUCTS, INC.** as a for foreign profit corporation, active and organized under the laws of the State of Florida, dated March 10, 2015 and filed by the Secretary of State.
(Submitted under NOA No. 15-0106.05)
3. Statement letter of conformance to, of complying with **FBC-2010**, and of no financial interest, dated 10/10/13, signed and sealed by Javad Ahmad, P. E.
(Submitted under NOA No. 13-1021.03)
4. Statement letter dated 08/21/13, issued by Aldora Aluminum & Glass Products, Inc. of legally purchase of asset and rights of **NOA No. 11-1208.01** from Pande Pane, LLC dba SMI Aluminum System, LLC and requesting that said NOA be issued under their name, signed by Manny Valladares, for and on behalf of Aldora Aluminum & Glass Products, Inc.
(Submitted under NOA No. 13-1021.03)



Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-1106.01
Expiration Date: **May 12, 2022**
Approval Date: **January 25, 2018**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

5. Letter from owners of existing NOA stating that they have sold all assets to the applicant, that they no longer manufacture the product and relinquish their rights to the current **NOA No. 11-1208.01**, dated 08/21/13, signed by Mr. Manny Valladares, for and on behalf of Pande Pane, LLC dba SMI Aluminum Systems, LLC.
(Submitted under NOA No. 13-1021.03)
6. Bill of Sale dated July 26, 2013, delivered by Aldora Holdco, Inc. transferring assets to Aldora Aluminum & Glass Products, Inc., signed by Mr. Scott Hauncher, Vice President, Aldora Holdco, Inc.
(Submitted under NOA No. 13-1021.03)
7. Assignment & Assumption agreement dated July 26, 2013 between Aldora Holdings LLC, Pande Pane, LLC dba SMI Aluminum Systems, LLC, Architectural Glass Products, LLC (each an "Assignor" and collectively, the "Assignors") and Aldora Holdco, Inc. (the "Assignee") signed by Leon Silverstein, Aldora Holdings LLC manager; Leon Silverstein, SMI Aluminum Systems, LLC, manager; Leon Silverstein, Architectural Glass Products, LLC manager and Scott Hauncher, VP Aldora Holdco, Inc.
(Submitted under NOA No. 13-1021.03)
8. Department of State Certification of **ALDORA ALUMINUM & GLASS PRODUCTS, INC.** as a for foreign profit corporation, active and organized under the laws of the State of Delaware, dated July 18, 2013 and signed by Jeffrey W. Bullock, Secretary of State.
(Submitted under NOA No. 13-1021.03)
9. Department of State Certification of **ALDORA ALUMINUM & GLASS PRODUCTS, INC.** as a for foreign profit corporation, active and organized under the laws of the State of Florida, dated July 20, 2013 and signed by T. Burgh, Secretary of State.
(Submitted under NOA No. 13-1021.03)
10. Laboratory compliance letter for Test Reports No.'s **BT-ALD-15-008** and **BT-ALD-15-009**, issued by Blackwater Testing, Inc., dated 02/15 and 02/18/16 respectively, both signed and sealed by Yamil Gerardo Kuri, P. E.
11. Proposal No. **16-0633**, issued by the Product Control Section, dated 08/26/2016, signed by Ishaq I. Chanda, P. E.
12. Testing agreement from manufacturer and testing laboratory requesting a 1-year extension to allow time to perform verification test, dated 04/28/10, signed by Frank H. Messa, V.P., respectively for SMI Systems and by Leigh B. Sanchez, V.P., respectively for Fenestration Testing Laboratory, Inc.
(Submitted under NOA No. 15-0106.05)


Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-1106.01
Expiration Date: May 12, 2022
Approval Date: January 25, 2018

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

13. Laboratory compliance letter for Test Reports No.'s **FTL-4267, FTL-4238, FTL-4257, FTL-4276**, all issued by Fenestration Testing Laboratory, Inc., dated 16/18/04, 06/30/04, 08/12/04 and 08/13/04 all respectively, signed and sealed by Edmundo J. Largaespada, P. E. *(Submitted under NOA No. 05-0301.04)*
14. Proposal No. **03-0384**, issued by the Product Control, dated 04/01/2004, signed by Jaime D. Gascon, P. E. *(Submitted under NOA No. 05-0301.04)*

G. OTHERS

1. Notice of Acceptance No. **15-0106.05**, issued to Aldora Aluminum & Glass Products, Inc. for their Series "**K2LM 10'-0" Outswing Glazed Aluminum Entrance Door - L.M.I.**", approved on 04/02/15 and expiring on 05/12/16.

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W04-91**, titled "Series K2LM Alum. Out-Swing Entrance Door", sheets 1 through 4, 4.1, 4.2, 5 through 8, 8.1, 9, 9.1, 10, 11 and 11.1 of 11, dated 10/25/04, with revision "**J**" dated 01/05/18, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. None.

C. CALCULATIONS

1. Structural analysis, complying with **FBC 6th Edition (2017)**, prepared by Al-Farooq Corporation, dated 10/24/17 and 01/08/18, signed and sealed by Javad Ahmad, P. E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **17-0712.05** issued to **Eastman Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" dated 09/07/17, expiring on 05/21/21.
2. Notice of Acceptance No. **17-0712.04** issued to **Eastman Chemical Company (MA)** for their "**Saflex HP Clear or Color Glass Interlayers**" dated 09/07/17, expiring on 04/14/18.



Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-1106.01
Expiration Date: May 12, 2022
Approval Date: January 25, 2018

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS (CONTINUED)

3. Notice of Acceptance No. **17-0919.09** issued to **Allnex USA, Inc.** for their “**Uvekol S Laminated Glass Interlayer**”, dated 12/28/17, expiring on 02/08/19.

F. STATEMENTS

1. Statement letter of conformance to **FBC 6th Edition (2017)**, and of no financial interest, dated 10/24/17, signed and sealed by Javad Ahmad, P. E.
2. Letter of clarification for Test Reports No. **BT-ALD-15-009**, issued by Blackwater Testing, Inc., dated 04/10/17 respectively, signed and sealed by Yamil Gerardo Kuri, P. E.

G. OTHERS

1. This NOA revises NOA #17-1106.01, expiring on 05/12/2018.



Jorge M. Plasencia, P. E.
Product Control Unit Supervisor
NOA No. 17-1106.01
Expiration Date: May 12, 2022
Approval Date: January 25, 2018

FRAME WIDTH = DOOR OPNG. WIDTH + 3.500

LEAF HEIGHT = DOOR FRAME HEIGHT - 2.188"

LEAF WIDTH (XX DOORS) = (DOOR OPNG. WIDTH - .250)/2

LEAF WIDTH (X DOORS) = DOOR OPNG. WIDTH - .187

GLASS DLO HEIGHT = LEAF HEIGHT - 14.375

GLASS DLO WIDTH = LEAF WIDTH - 9.813

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

SERIES K2LM ALUMINUM OUT-SWING DOOR

USE BUMPER THRESHOLD (#5A+5B) WHEN WATER INFILTRATION REQUIREMENTS ARE NOT APPLICABLE.


USE HIGH-RISE THRESHOLD COVER (#5A+5C) WHEN WATER INFILTRATION REQUIREMENTS MUST BE MET.

SEE CHARTS ON SHEET 2 FOR DESIGN LOAD CAPACITY OF SINGLE (X) AND DOUBLE (XX) LEAF DOORS W/O TRANSOMS.


SEE CHARTS ON SHEET 3 FOR DESIGN LOAD CAPACITY OF SINGLE (O/X) OR DOUBLE (O/XX) LEAF DOORS WITH TRANSOMS.

SEE CHARTS ON SHEETS 5 & 6 FOR DESIGN LOAD CAPACITY OF DOOR MULLION.

USE LOWER VALUES OF DOOR MULLION CHARTS (SHEETS 5 & 6) OR DOOR CAPACITY CHARTS (SHEETS 2 & 3).

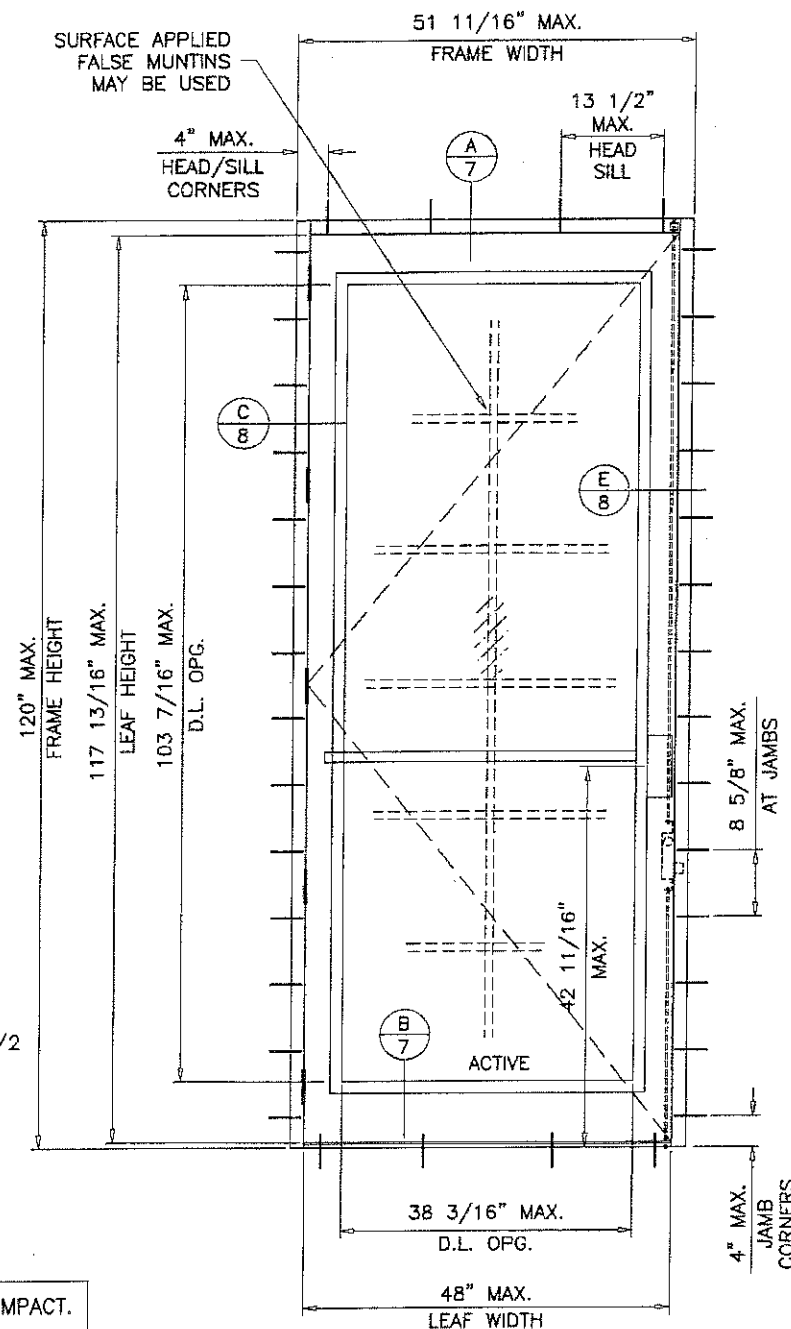

TOTAL NO. OF ANCHORS AT MTC, STILE ENDS	
SUBSTRATE	FOR FRAME HT. UPTO 120 IN.
WOOD	8
CONCRETE	6
METAL	6

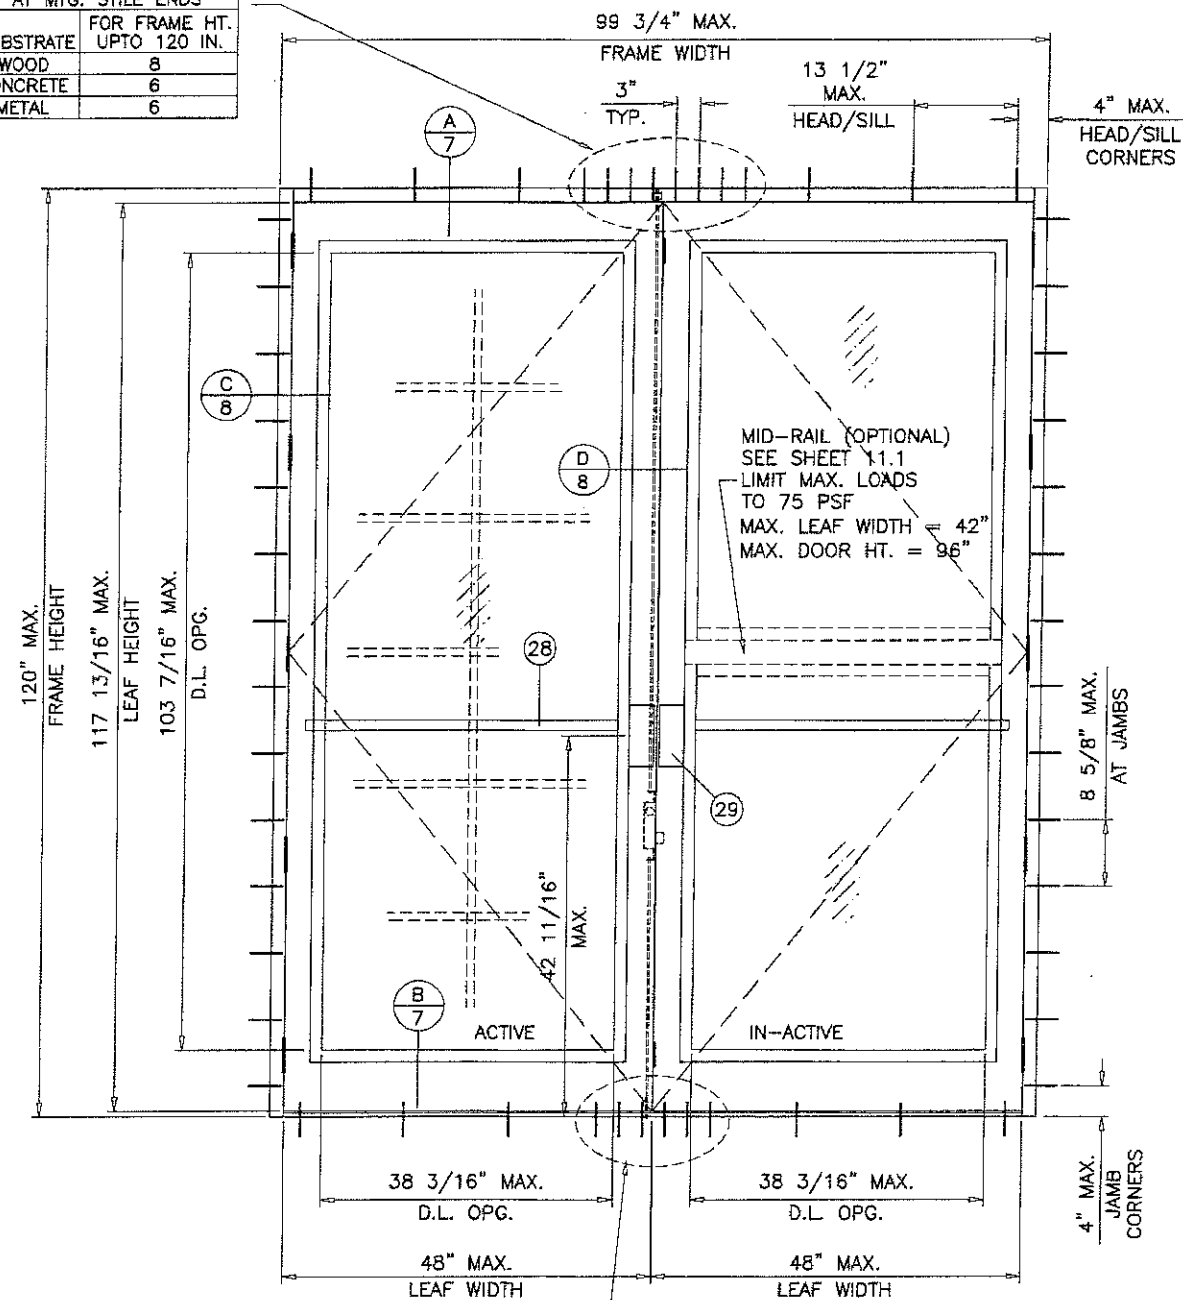

TYPICAL ELEVATIONS

NOTES:

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2017 (6TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2017 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.


JAN 08 2018

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01

Expiration Date 05/12/2022

By 
Miami-Dade Product Control

LAMINATED GLASS
LARGE MISSILE IMPACT

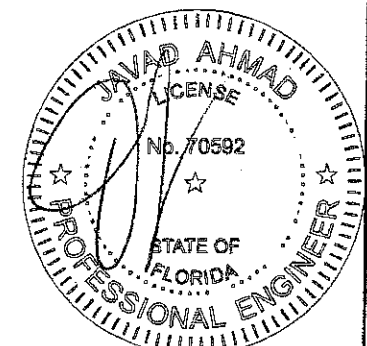

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
(C.A.N. 9598)

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL (305) 888-6288 FAX (305) 888-6289

revisions:	no.	date	by	description
	F	08.12.13	MANUF. NAME REV.	
	G	12.15.14	UPDATED TO 2014 FBC	
	H	1.11.17	REV. PER RER COMMENTS	
	I	09.05.17	REV. PER RER COMMENTS	
	J	01.05.18	REV. PER RER COMMENTS	


date: 10-25-04
scale: 1/2" = 1'-0"
dr. by: TARIQ
chk. by:

drawing no.

W04-91


sheet 1 of 11

COMP-AN\W04-91SM



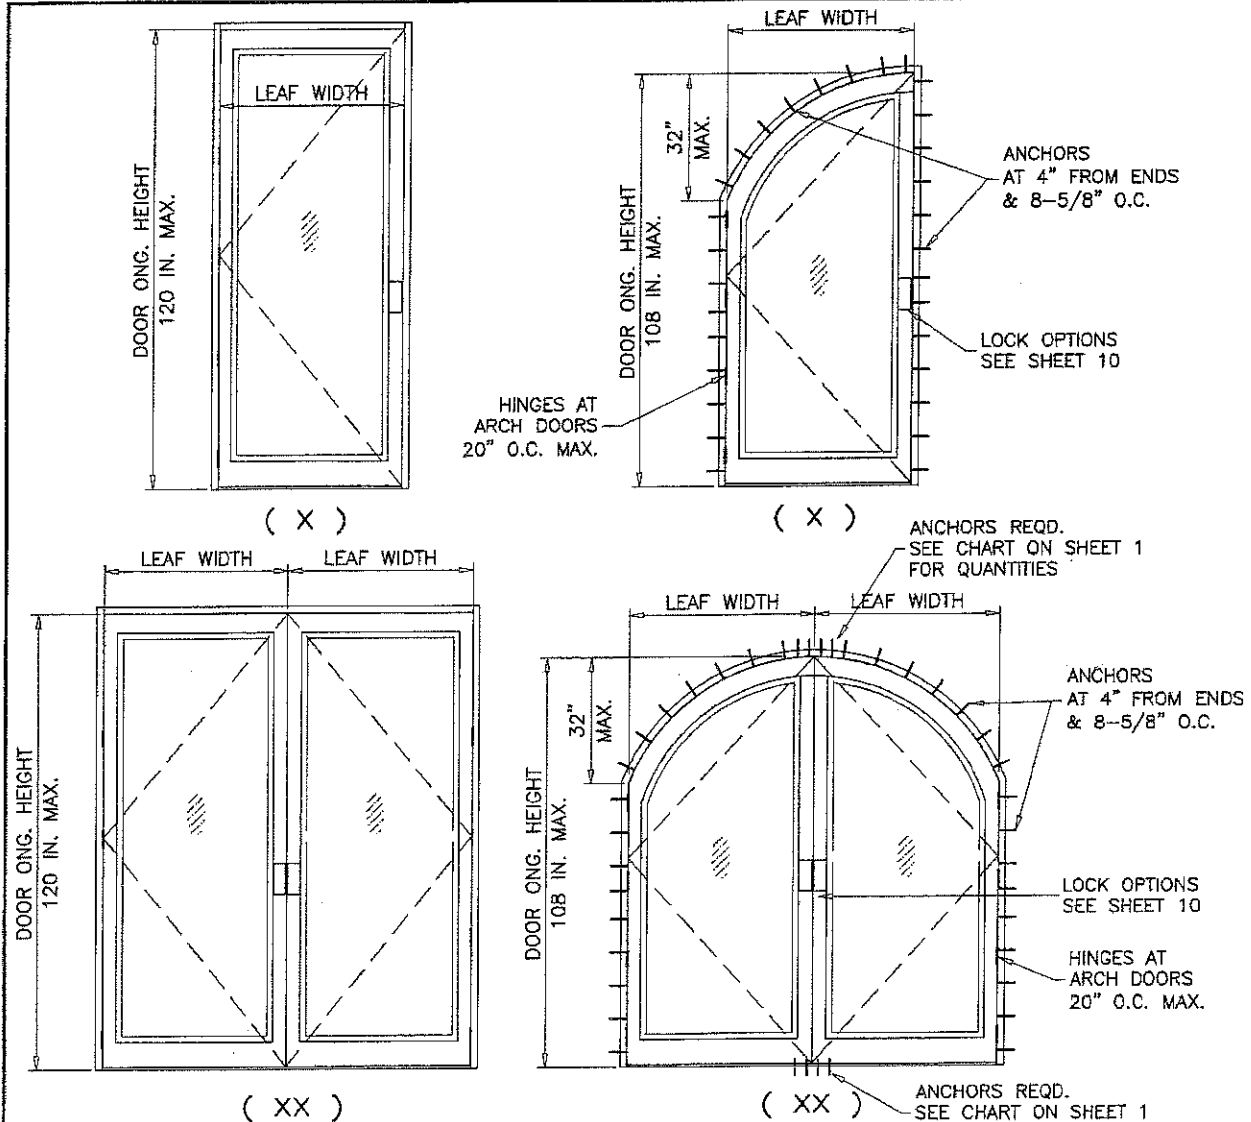


SINGLE OR DOUBLE ENTRANCE DOORS W/O TRANSOM GLASS TYPES 'A' & 'B'			
NOMINAL DIMS.		DESIGN LOAD CAPACITY-PSF	
DPNG. HEIGHT INCHES	LEAF WIDTH INCHES	EXT.(+)	INT.(-)
80	30	100.0	120.0
	36	100.0	120.0
	42	100.0	120.0
	48	100.0	120.0
84	30	100.0	120.0
	36	100.0	120.0
	42	100.0	120.0
	48	100.0	120.0
96	30	100.0	120.0
	36	100.0	120.0
	42	100.0	120.0
	48	100.0	120.0
108	30	100.0	120.0
	36	100.0	120.0
	42	100.0	120.0
	48	100.0	120.0
120	30	100.0	100.0
	36	100.0	100.0
	42	100.0	100.0
	48	100.0	100.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

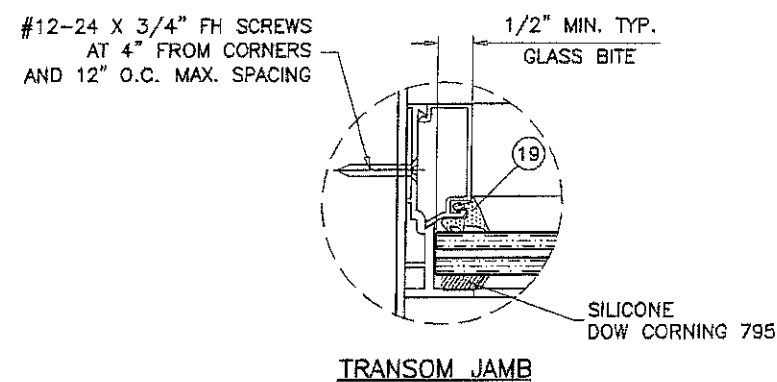

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**
Expiration Date **05/12/2022**
By **Miami-Dade Product Control**

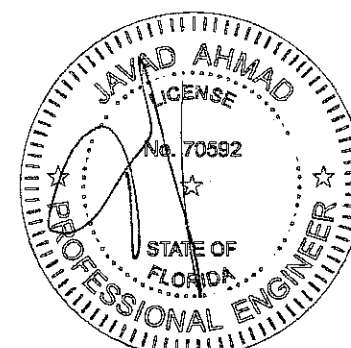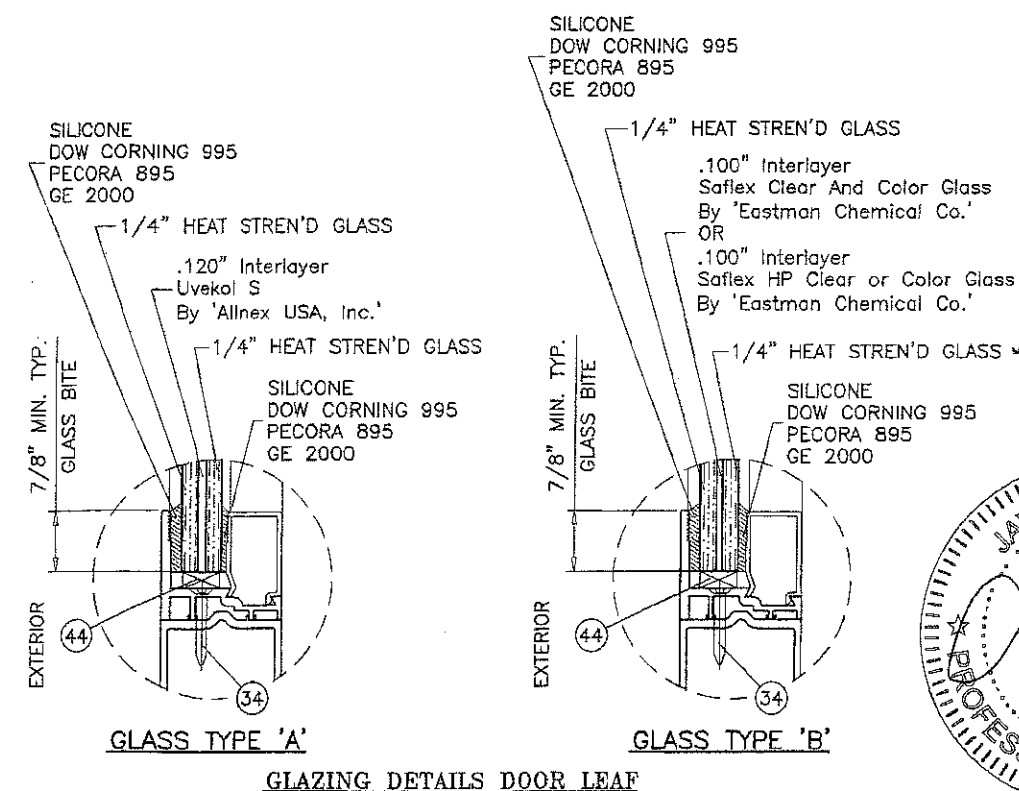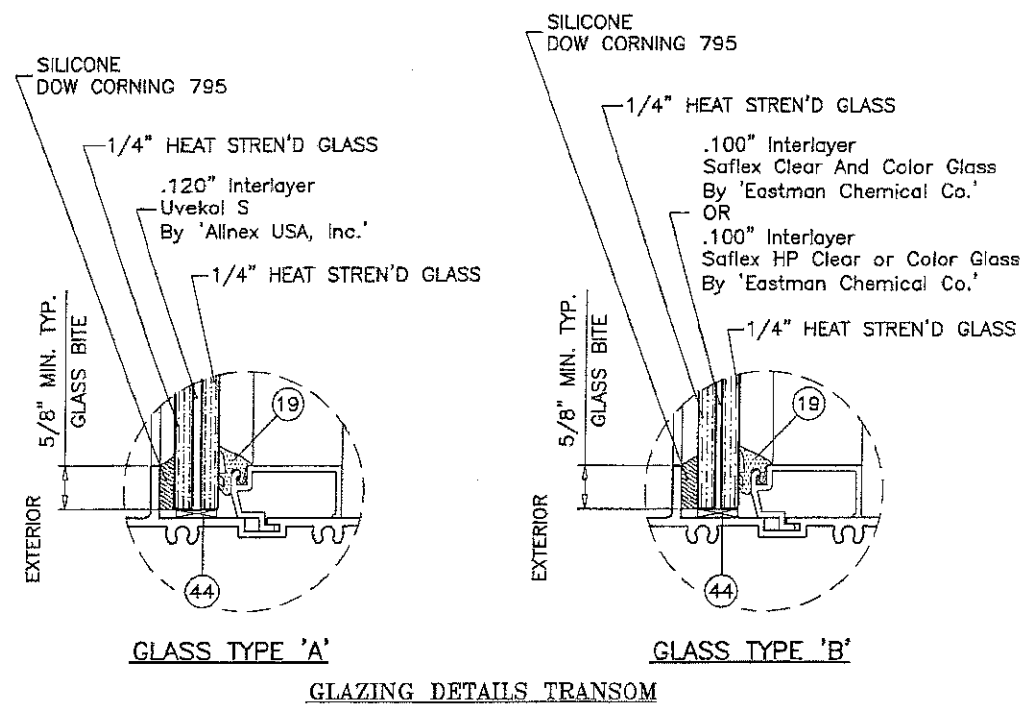

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR

Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

no	date	by	description
F	08.12.13		MANUF. NAME REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		EDITORIAL CHANGES
I	09.05.17		REV. PER PER COMMENTS
J	01.05.18		REV. PER PER COMMENTS

date: 10-25-04

scale: 1/2" = 1'-0"


dr. by: TARIQ

chk. by:

drawing no.
W04-91

sheet 2 of 11


SINGLE ENTRANCE DOORS WITH TRANSOM					
DESIGN LOAD CAPACITY					
NOMINAL DIMS.			WITHOUT REINF.		
OPNG. WIDTH INCHES	DOOR HEIGHT INCHES	TRANSOM HEIGHT INCHES	EXT. (+)	INT. (-)	
48 MAX.	108 MAX.	60	100.0	120.0	

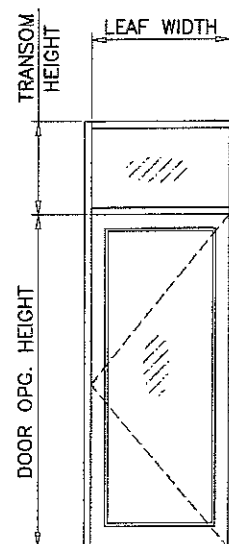


(O/X)

DOUBLE ENTRANCE DOORS WITH TRANSOM GLASS TYPES 'A' & 'B'						
DESIGN LOAD CAPACITY						
NOMINAL DIMS.			WITHOUT REINF.		WITH REINF.	
OPNG. WIDTH INCHES	DOOR HEIGHT INCHES	TRANSOM HEIGHT INCHES	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
60	80	24	100.0	120.0	100.0	120.0
		30	100.0	120.0	100.0	120.0
		36	100.0	120.0	100.0	120.0
		42	85.7	102.9	85.7	102.9
		48	75.0	90.0	75.0	90.0
		54	66.7	80.0	66.7	80.0
72		24	100.0	103.0	100.0	120.0
		30	97.4	97.4	100.0	120.0
		36	92.3	92.3	100.0	120.0
		42	85.7	87.8	85.7	102.9
		48	75.0	83.7	75.0	90.0
84		24	74.9	74.9	100.0	120.0
		30	70.8	70.8	100.0	120.0
		36	67.1	67.1	100.0	120.0
96"		24	56.8	56.8	100.0	110.0
		30	53.7	53.7	100.0	104.0
		36	50.9	50.9	98.6	98.6
60		84	24	100.0	120.0	100.0
	30		100.0	120.0	100.0	120.0
	36		100.0	120.0	100.0	120.0
	42		85.7	102.9	85.7	102.9
	48		75.0	90.0	75.0	90.0
	54		66.7	80.0	66.7	80.0
72	24		99.2	99.2	100.0	120.0
	30		94.0	94.0	100.0	120.0
	36		89.3	89.3	100.0	120.0
	42		85.0	85.0	85.7	102.9
	48		75.0	81.1	75.0	90.0
84	24		72.1	72.1	100.0	120.0
	30		68.3	68.3	100.0	120.0
	36		64.9	64.9	100.0	120.0
96"	24		54.7	54.7	100.0	105.9
	30		51.8	51.8	100.0	100.4
	36		49.2	49.2	95.3	95.3
60	96		24	100.0	120.0	100.0
		30	100.0	120.0	100.0	120.0
		36	100.0	118.2	100.0	120.0
		42	85.7	102.9	85.7	102.9
		48	75.0	90.0	75.0	90.0
72		24	89.3	89.3	100.0	120.0
		30	85.0	85.0	100.0	120.0
		36	81.1	81.1	100.0	120.0
		42	77.6	77.6	85.7	102.9
		48	74.4	74.4	75.0	90.0
84		24	64.9	64.9	100.0	120.0
		30	61.8	61.8	100.0	118.6
		36	59.0	59.0	100.0	113.2
96"		24	49.2	49.2	95.3	95.3
		30	46.9	46.9	90.8	90.8
		36	44.7	44.7	86.7	86.7


DOUBLE ENTRANCE DOORS WITH TRANSOM GLASS TYPES 'A' & 'B'						
DESIGN LOAD CAPACITY						
NOMINAL DIMS.			WITHOUT REINF.		WITH REINF.	
OPNG. WIDTH INCHES	DOOR HEIGHT INCHES	TRANSOM HEIGHT INCHES	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
60	108	24	100.0	118.2	100.0	120.0
		30	100.0	113.0	100.0	120.0
		36	100.0	108.3	100.0	120.0
		42	—	—	85.7	102.9
72		24	81.1	81.1	100.0	120.0
		30	77.6	77.6	100.0	120.0
		36	74.4	74.4	100.0	120.0
84		24	59.0	59.0	100.0	113.2
		30	56.4	56.4	100.0	108.3
		36	54.1	54.1	100.0	103.8
96"		24	44.7	44.7	86.7	86.7
		30	42.8	42.8	82.5	82.9
	36	41.0	41.0	79.5	79.5	

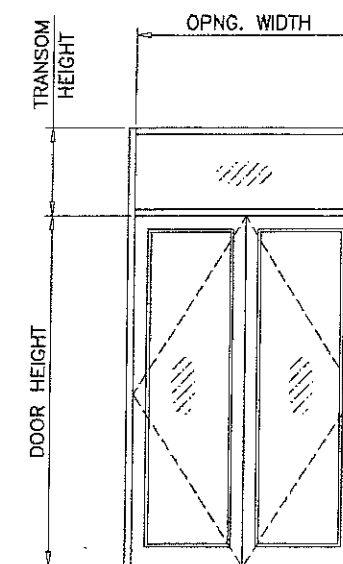

(O/XX)



TRANSOM
WITHOUT REINF.




TRANSOM
WITH REINF.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01
Expiration Date 05/12/2022

By 
Miami-Dade Product Control

JAN 08 2018

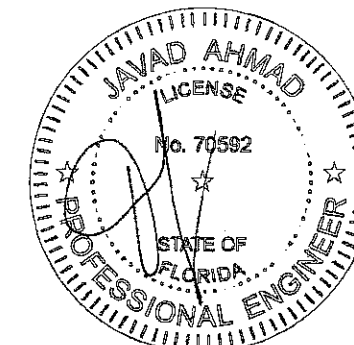

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR

Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

no	date	by	description
F	08.12.13		MANUF. NAME REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		REV. PER RER COMMENTS
I	09.05.17		CHART REVISED
J	01.05.18		REV. PER RER COMMENTS

date: 10-25-04


scale: 1/2"=1'-0"

dr. by: TARIQ


chk. by:

drawing no.
W04-91

sheet 3 of 11

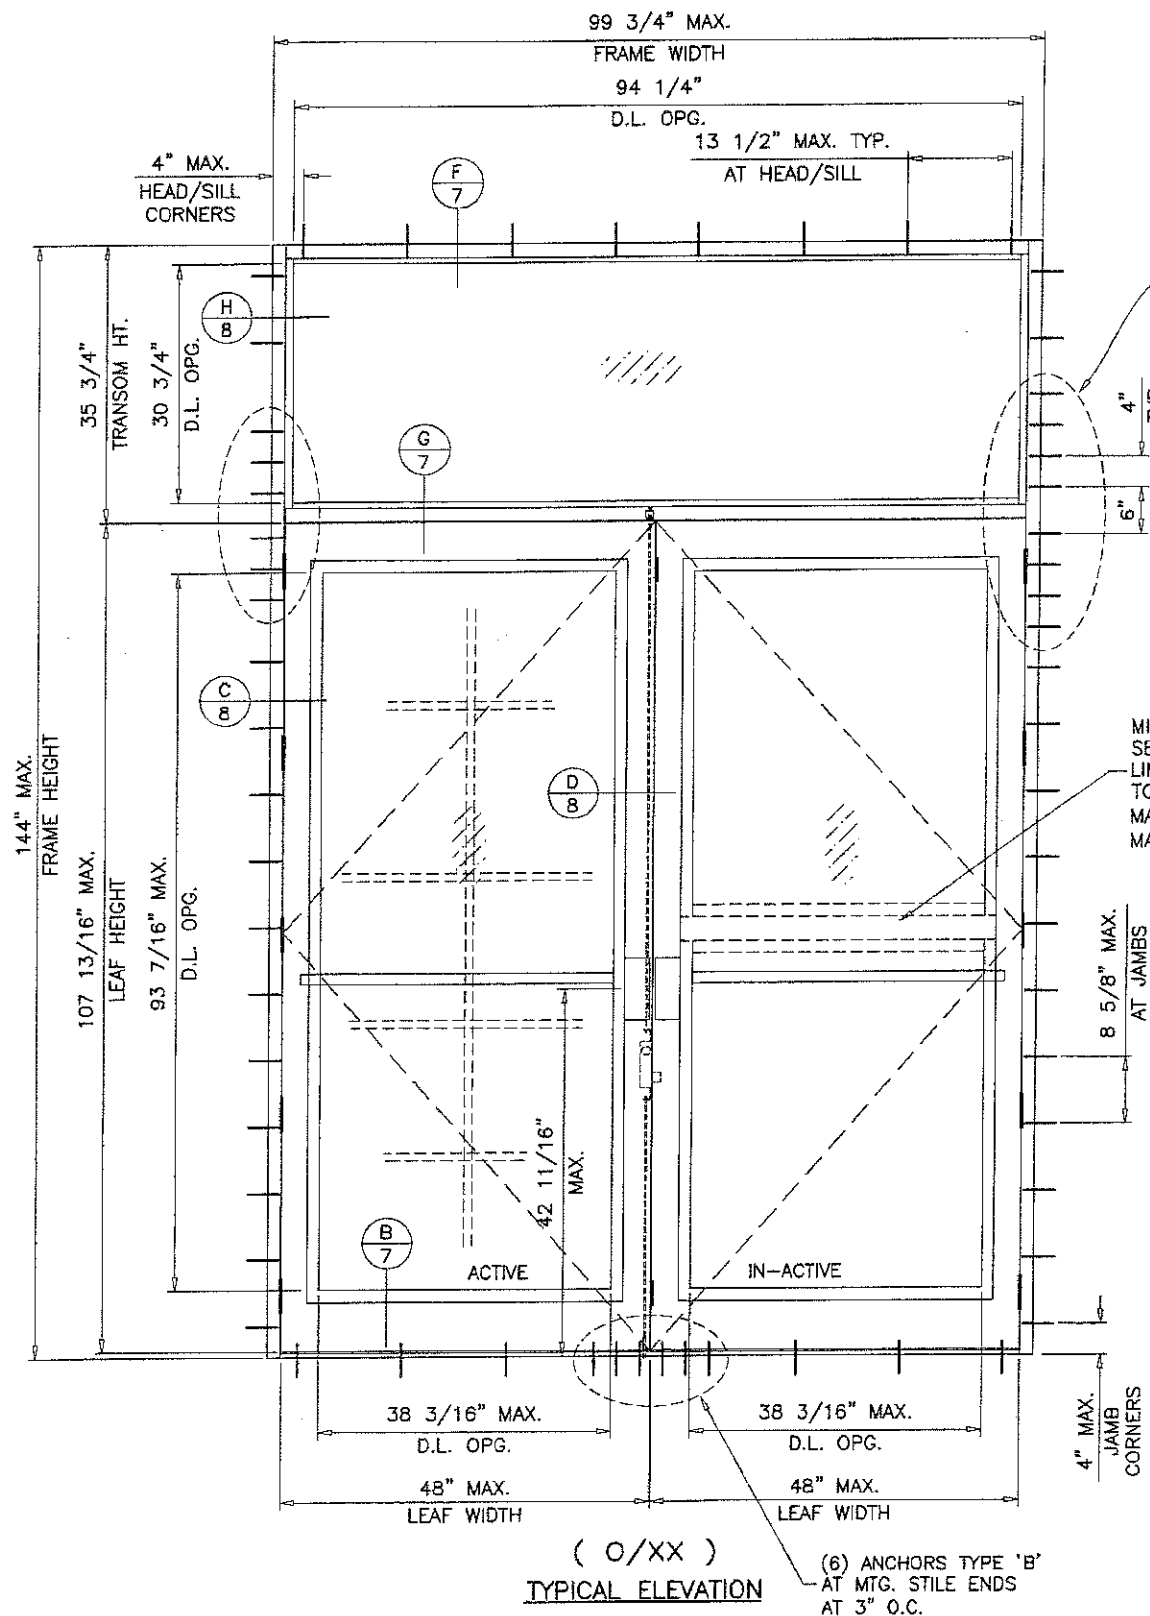

SUBSTRATE	NO. OF ANCHORS AT TRANSOM ENDS	
	WITHOUT REINF.	WITH REINF.
WOOD	6	8
MASONRY	6	8
CONCRETE	4	4
METAL	4	5

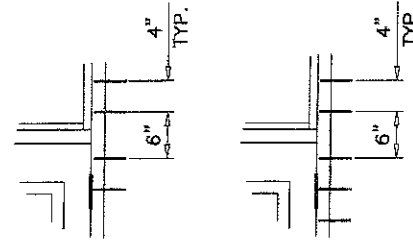


MID-RAIL (OPTIONAL)
SEE SHEET 11.1
LIMIT MAX. LOADS
TO 75 PSF
MAX. LEAF WIDTH = 42\"/>

DLO WIDTH (TRANSOM) = DOOR FRAME WIDTH - 5.50\"/>

NOTE:
FOR DOORS CAPACITY SEE SHEET 2.
FOR HORIZONTAL MULLION (TRANSOM BAR) CAPACITY SEE SHEET 3.
LOWER VALUES FROM DOORS OR HORIZONTAL MULLION (TRANSOM BAR) CHART
WILL APPLY TO ENTIRE SYSTEM.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01
Expiration Date 05/12/2022
By 
Miami-Dade Product Control

JAN 08 2018

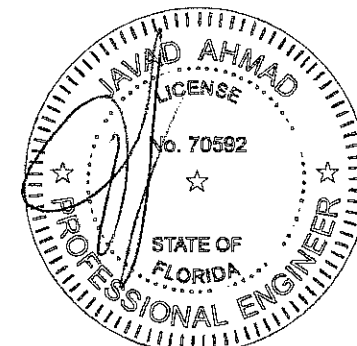


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-8978

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

no	date	by	description
F	08.12.13		MANUF. NAME REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		REV. PER RER COMMENTS
I	09.05.17		REV. PER RER COMMENTS
J	01.05.18		REV. PER RER COMMENTS


date: 10-25-04
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:
drawing no.
W04-91
sheet 4 of 11

COMP-ANL W04-91SM

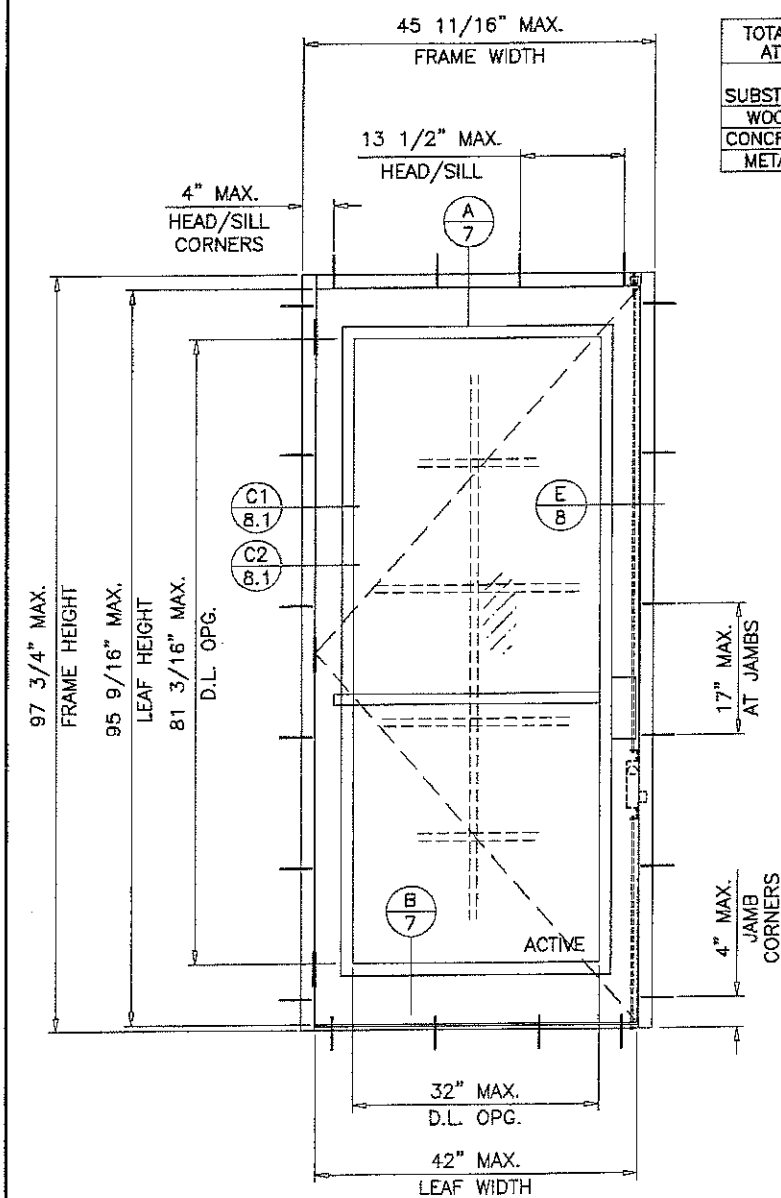


(X)
TYPICAL ELEVATION

TOTAL NO. OF ANCHORS AT MTG. STILE ENDS	
SUBSTRATE	FOR FRAME HT. UPTO 97-3/4"
WOOD	8
CONCRETE	6
METAL	6

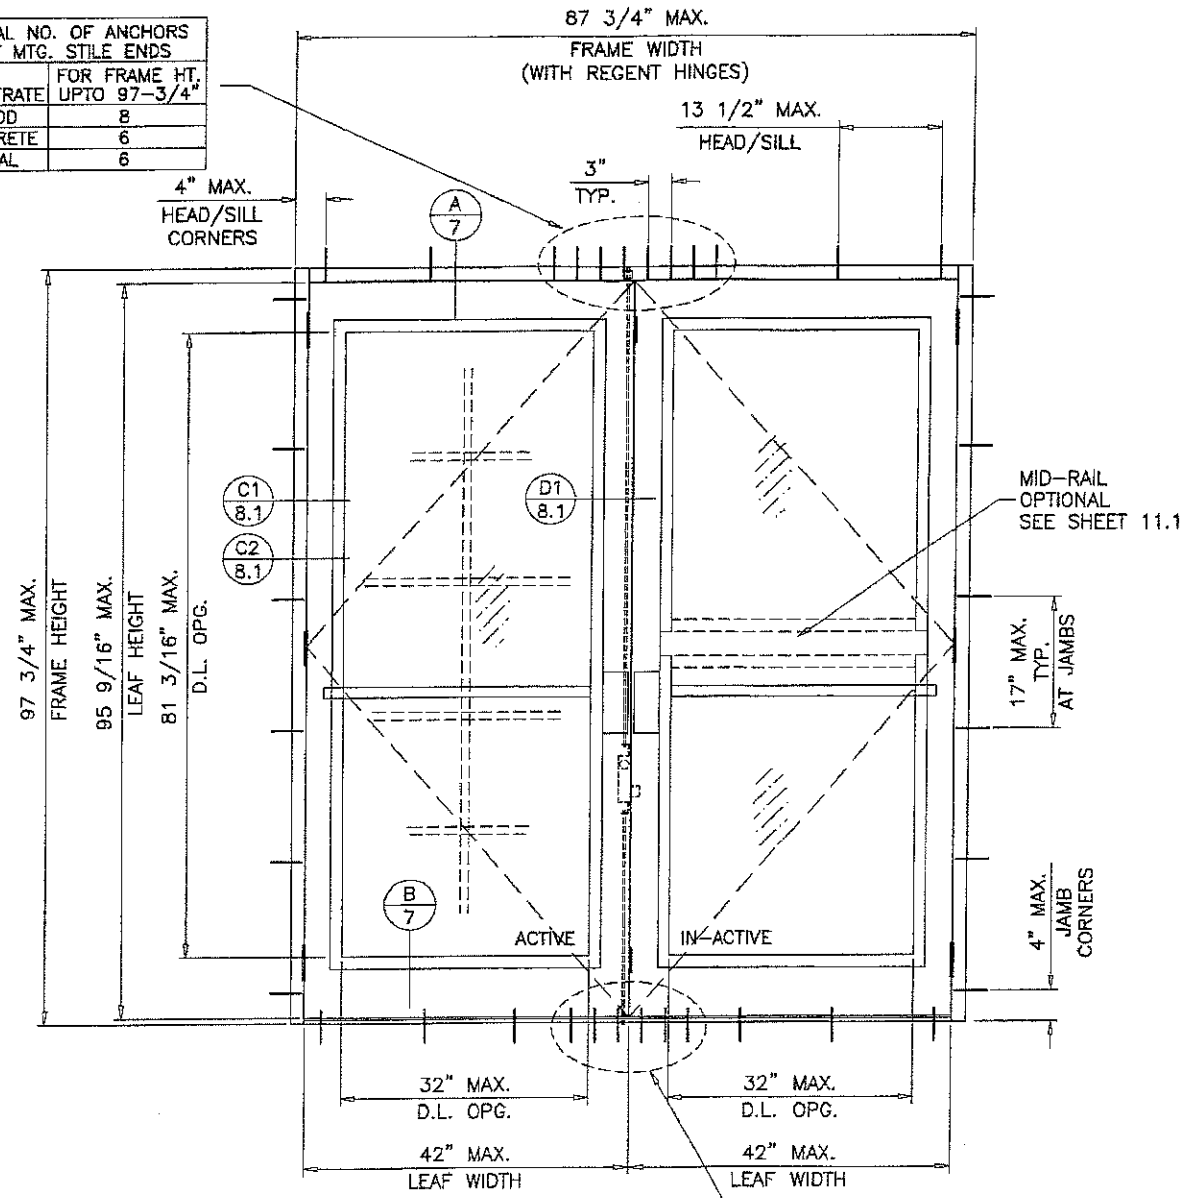

(XX)
TYPICAL ELEVATION

GLASS TYPE 'C' ONLY
MAXIMUM DESIGN LOAD RATING = + 75.0 PSF
(FOR SIZES SHOWN ON THIS SHEET ONLY) - 75.0 PSF

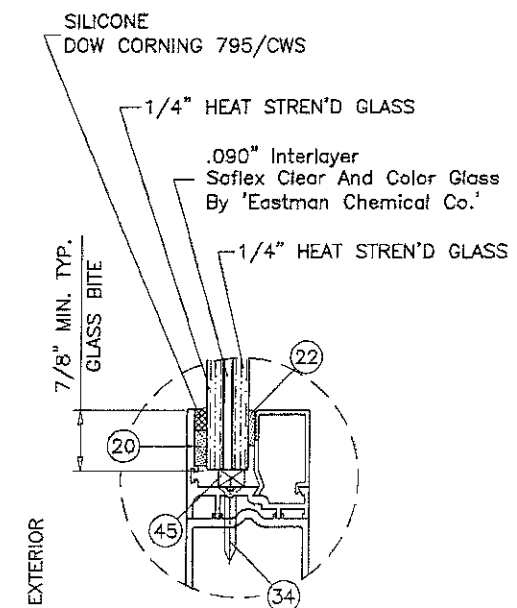

GLASS TYPE 'C'
GLAZING DETAIL DOOR LEAF

FRAME WIDTH = DOOR OPNG. WIDTH + 3.500

LEAF HEIGHT = DOOR FRAME HEIGHT - 2.188"

LEAF WIDTH (XX DOORS) = (DOOR OPNG. WIDTH - .250)/2 REGENT HINGES
= (DOOR OPNG. WIDTH - .750)/2 ALUMINUM HINGES

LEAF WIDTH (X DOORS) = DOOR OPNG. WIDTH - .187 REGENT HINGES
= DOOR OPNG. WIDTH - .437 ALUMINUM HINGES

GLASS DLO HEIGHT = LEAF HEIGHT - 14.375


GLASS DLO WIDTH = LEAF WIDTH - 10.000

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01

Expiration Date 05/12/2022

By
Miami-Dade Product Control

JAN 08 2010

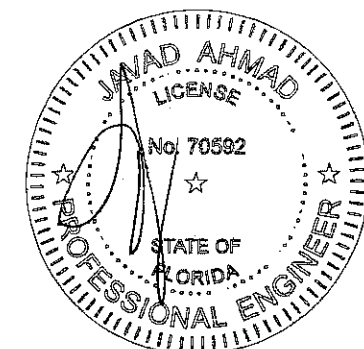


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-91SM


SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

revisions:		by description	
no	date		
H	1.11.17	REV. PER RER COMMENTS	
I	09.05.17	NO CHANGE THIS SHEET	
J	01.05.18	REV. PER RER COMMENTS	

date: 10-25-04
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:
drawing no.
W04-91
sheet 4.1 of 11

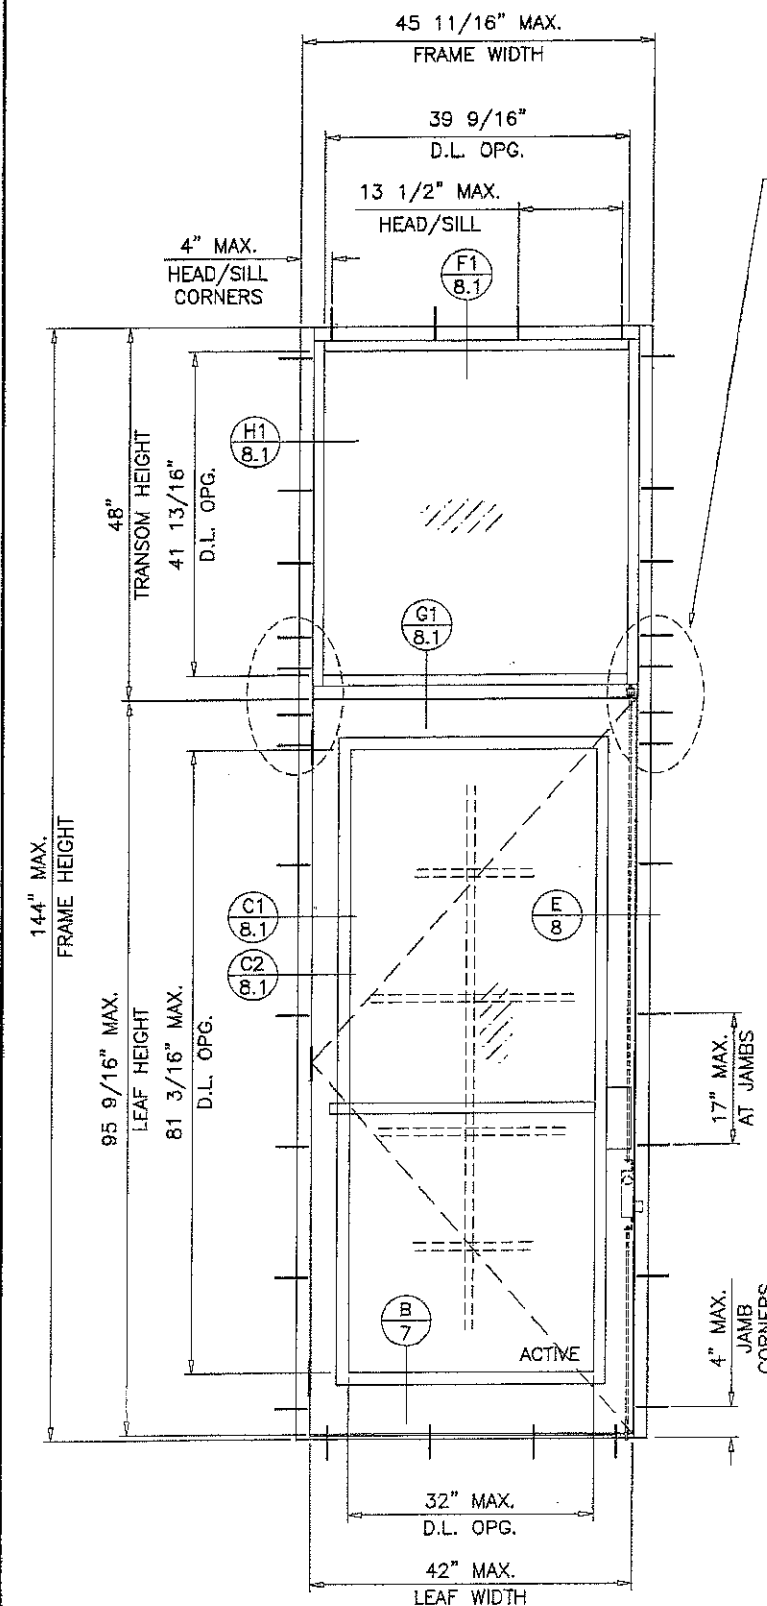

(O/X)
TYPICAL ELEVATION

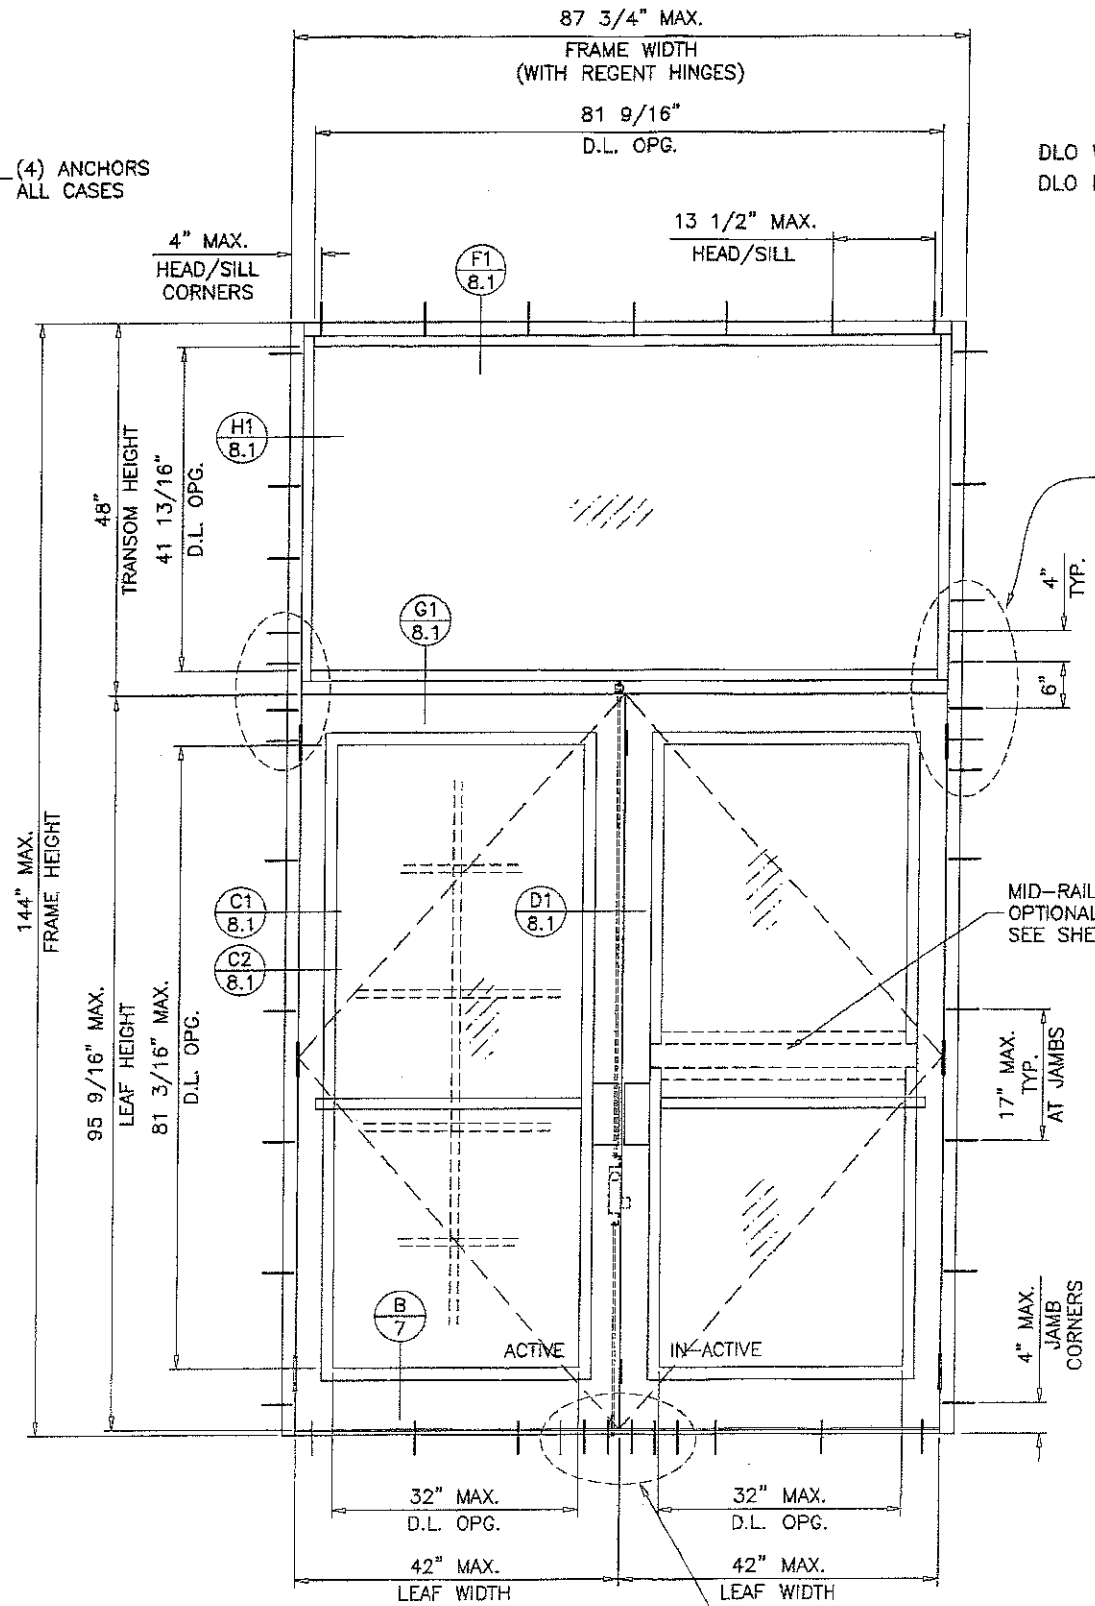

(O/XX)
TYPICAL ELEVATION

NOTE:
FOR DOORS CAPACITY SEE SHEET 4.1.
FOR HORIZONTAL MULLION (TRANSOM BAR) CAPACITY SEE CHART ABOVE.
LOWER VALUES FROM DOORS OR HORIZONTAL MULLION (TRANSOM BAR) CHART
WILL APPLY TO ENTIRE SYSTEM.

DLO WIDTH (TRANSOM) = DOOR FRAME WIDTH - 6.125"
DLO HEIGHT (TRANSOM) = TRANSOM HEIGHT - 6.125"


SUBSTRATE	NO. OF ANCHORS AT TRANSOM ENDS WITHOUT REINF.
WOOD	6
MASONRY	6
CONCRETE	4
METAL	4

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01


Expiration Date 05/12/2022

By
Miami-Dade Product Control

GLASS TYPE 'C' ONLY				
DOUBLE ENTRANCE DOORS WITH TRANSOM				
DESIGN LOAD CAPACITY				
NOMINAL DIMS.			WITHOUT REINF.	
OPNG. WIDTH INCHES	DOOR HEIGHT INCHES	TRANSOM HEIGHT INCHES	EXT. (+)	INT. (-)
82	96	42	70.5	70.5
		48	67.6	67.6
84-1/4	96	42	66.7	66.7
		48	63.9	63.9

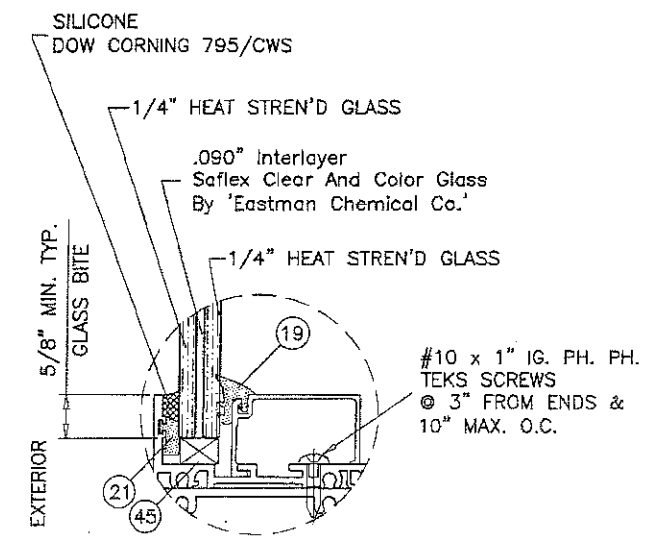

GLASS TYPE 'C'
GLAZING DETAIL TRANSOM

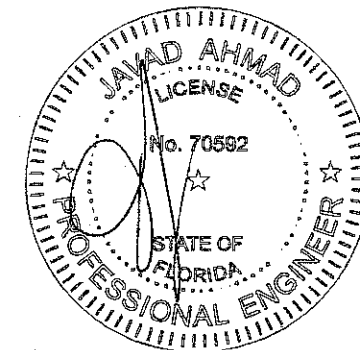

JAN 08 2019

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W04-91SM

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR



Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

revisions:	no	date	by	description
	H	1.11.17		REV. PER RER COMMENTS
	I	09.05.17		CHART REVISED
	J	01.05.18		REV. PER RER COMMENTS

date: 10-25-04
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:


drawing no.
W04-91
sheet 4.2 of 11

DOOR MULLION LOAD CAPACITY		
NOMINAL DIMS.		LOADS-PSF
WIDTH (W)	FRAME HEIGHT	EXT.(+) & INT.(-)
24"	80"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	84"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	90"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	96"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	102"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	108"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	114"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0
24"	120"	100.0
30"		100.0
36"		100.0
42"		100.0
48"		100.0
54"		100.0
60"		100.0

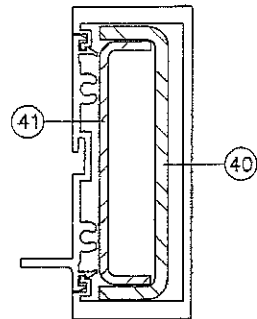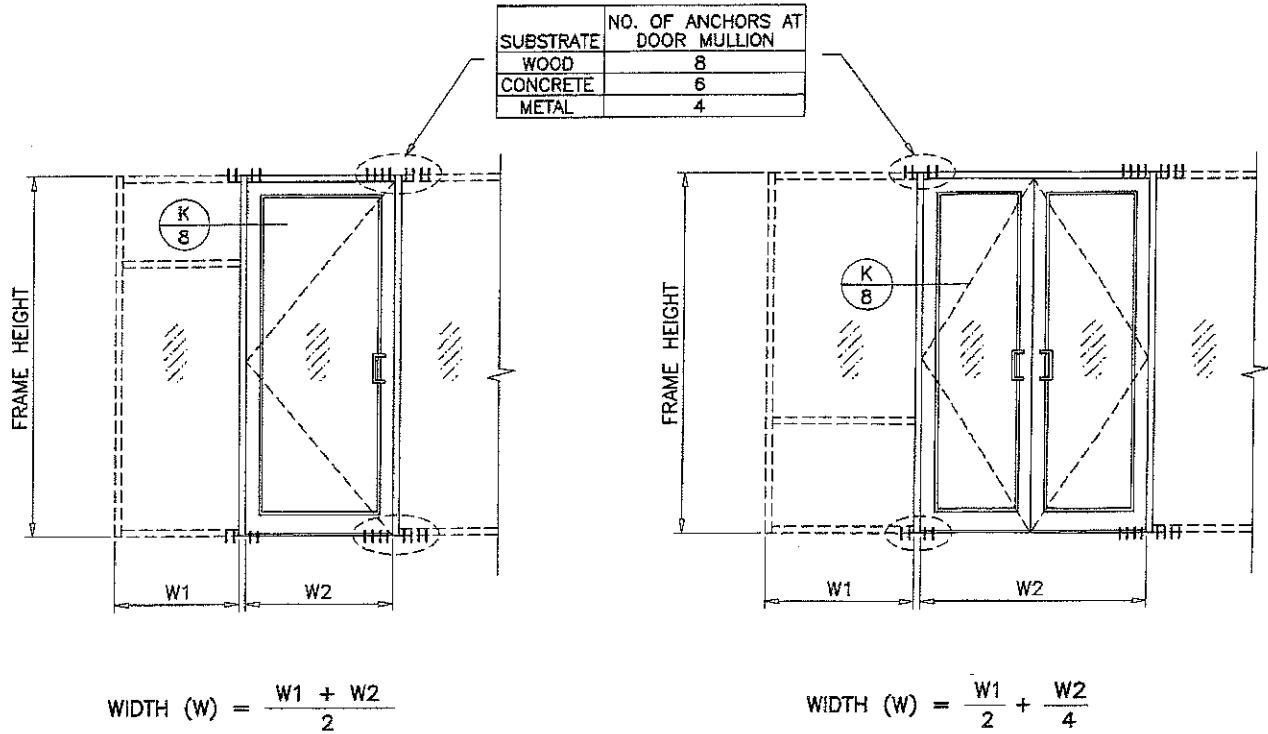

DOOR MULLION

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01
Expiration Date 05/12/2022
By *[Signature]*
Miami-Dade Product Control

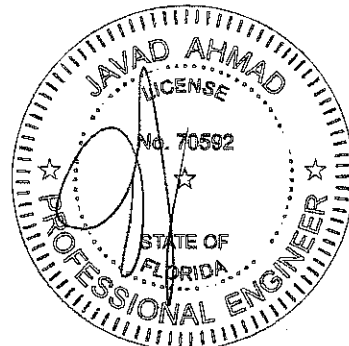

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR

Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

revisions:


no	date	by	description
F	08.12.13	MANUF. NAME REV.	
G	12.15.14	UPDATED TO 2014 FBC	
H	1.11.17	REV. PER PER COMMENTS	
I	08.05.17	REV. PER PER COMMENTS	
J	01.05.18	NO CHANGE THIS SHEET	

date: 10-25-04
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:


drawing no.
W04-91
sheet 5 of 11

COMP-ANL\W04-91SM

DOOR MULLION LOAD CAPACITY					DOOR MULLION LOAD CAPACITY					DOOR MULLION LOAD CAPACITY					DOOR MULLION LOAD CAPACITY				
NOMINAL DIMS.				LOADS-PSF	NOMINAL DIMS.				LOADS-PSF	NOMINAL DIMS.				LOADS-PSF	NOMINAL DIMS.				LOADS-PSF
DOOR WIDTH W1	SIDELITE WIDTH W2	DOOR HEIGHT A	FRAME SPAN L	EXT. (+) INT. (-)	DOOR WIDTH W1	SIDELITE WIDTH W2	DOOR HEIGHT A	FRAME SPAN L	EXT. (+) INT. (-)	DOOR WIDTH W1	SIDELITE WIDTH W2	DOOR HEIGHT A	FRAME SPAN L	EXT. (+) INT. (-)	DOOR WIDTH W1	SIDELITE WIDTH W2	DOOR HEIGHT A	FRAME SPAN L	EXT. (+) INT. (-)
60"	30"	80"	108"	100.0	60"	30"	84"	108"	100.0	60"	30"	96"	108"	100.0	60"	30"	108"	114"	100.0
	33"			100.0		33"			100.0		33"			100.0		33"			100.0
	39"			100.0		39"			100.0		39"			100.0		39"			100.0
	42"			100.0		42"			100.0		42"			100.0		42"			100.0
72"	30"			100.0	72"	30"			100.0	72"	30"			100.0	72"	30"			100.0
	33"			100.0		33"			100.0		33"			100.0		33"			100.0
	39"			100.0		39"			100.0		39"			100.0		39"			100.0
	42"			100.0		42"			100.0		42"			100.0		42"			100.0
84"	30"			100.0	84"	30"			100.0	84"	30"			100.0	84"	30"			100.0
	33"			100.0		33"			100.0		33"			100.0		33"			100.0
	39"			97.6		39"			100.0		39"			100.0		39"			100.0
	42"			95.0		42"			97.8		42"			100.0		42"			100.0
96"	30"			96.2	96"	30"			99.4	96"	30"			100.0	96"	30"			100.0
	33"			93.7		33"			96.8		33"			100.0		33"			100.0
	39"			89.2		39"			91.9		39"			100.0		39"			100.0
	42"			87.1		42"			89.7		42"			100.0		42"			100.0
60"	30"	80"	114"	100.0	60"	30"	84"	114"	100.0	60"	30"	96"	114"	100.0	60"	30"	108"	120"	100.0
	33"			100.0		33"			100.0		33"			100.0		33"			100.0
	39"			100.0		39"			100.0		39"			100.0		39"			100.0
	42"			100.0		42"			100.0		42"			100.0		42"			100.0
72"	30"			100.0	72"	30"			100.0	72"	30"			100.0	72"	30"			100.0
	33"			100.0		33"			100.0		33"			100.0		33"			100.0
	39"			94.3		39"			96.4		39"			100.0		39"			100.0
	42"			91.7		42"			93.6		42"			100.0		42"			98.4
84"	30"			92.6	84"	30"			94.8	84"	30"			100.0	84"	30"			100.0
	33"			90.0		33"			92.2		33"			100.0		33"			99.3
	39"			85.4		39"			87.3		39"			96.0		39"			90.3
	42"			83.2		42"			85.1		42"			93.3		42"			93.9
96"	30"			83.9	96"	30"			86.1	96"	30"			95.8	96"	30"			91.1
	33"			81.8		33"			83.9		33"			93.1		33"			
	39"			78.0		39"			79.8		39"			88.1		39"			
	42"					42"					42"					42"			
60"	30"	80"	120"	100.0	60"	30"	84"	120"	100.0	60"	30"	96"	120"	100.0	60"	30"			100.0
	33"			99.8		33"			100.0		33"			100.0		33"			100.0
	39"			93.6		39"			95.0		39"			100.0		39"			100.0
	42"			90.7		42"			92.1		42"			98.1		42"			100.0
72"	30"			91.3	72"	30"			93.0	72"	30"			100.0	72"	30"			97.3
	33"			88.6		33"			90.2		33"			97.3		33"			91.3
	39"			83.7		39"			85.1		39"			91.3		39"			88.6
	42"			81.4		42"			82.7		42"			88.6		42"			90.5
84"	30"			81.9	84"	30"			83.4	84"	30"			90.5	84"	30"			87.9
	33"			79.7		33"			81.2		33"			87.9		33"			83.0
	39"			75.6		39"			77.0		39"			83.0		39"			80.7
	42"			73.8		42"			75.0		42"			80.7		42"			82.3
96"	30"			74.2	96"	30"			75.7	96"	30"			82.3	96"	30"			
	33"			72.4		33"			73.8		33"			80.1		33"			

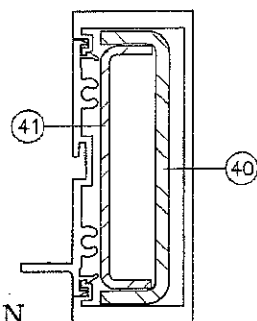

DOOR MULLION

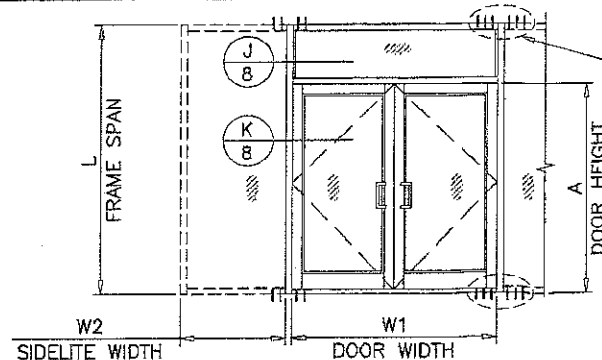


SUBSTRATE	NO. OF ANCHORS AT DOOR MULLION
WOOD	12
CONCRETE	8
METAL	6

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01

Expiration Date 05/12/2022

By 
Miami-Dade Product Control

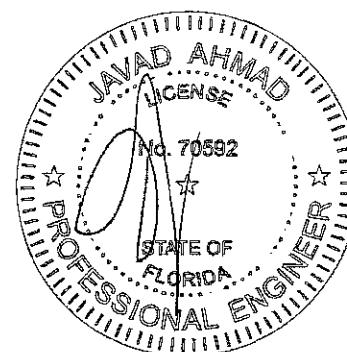

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

revisions:	no	date	by	description
	F	08.12.13		MANUF. NAME REV.
	G	12.15.14		UPDATED TO 2014 FBC
	H	1.11.17		REV. PER RER COMMENTS
	I	09.05.17		REV. PER RER COMMENTS
	J	01.05.18		NO CHANGE THIS SHEET



date: 10-25-04
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.
W04-91
sheet 6 of 11

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-9100 FAX. (305) 262-6978
(C.A.N. 9338)

COMP-ANL\W04-91SM

JAN 08 2019

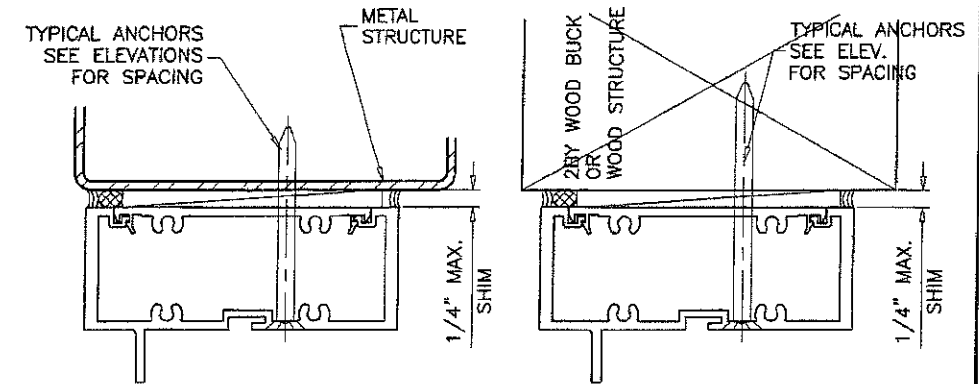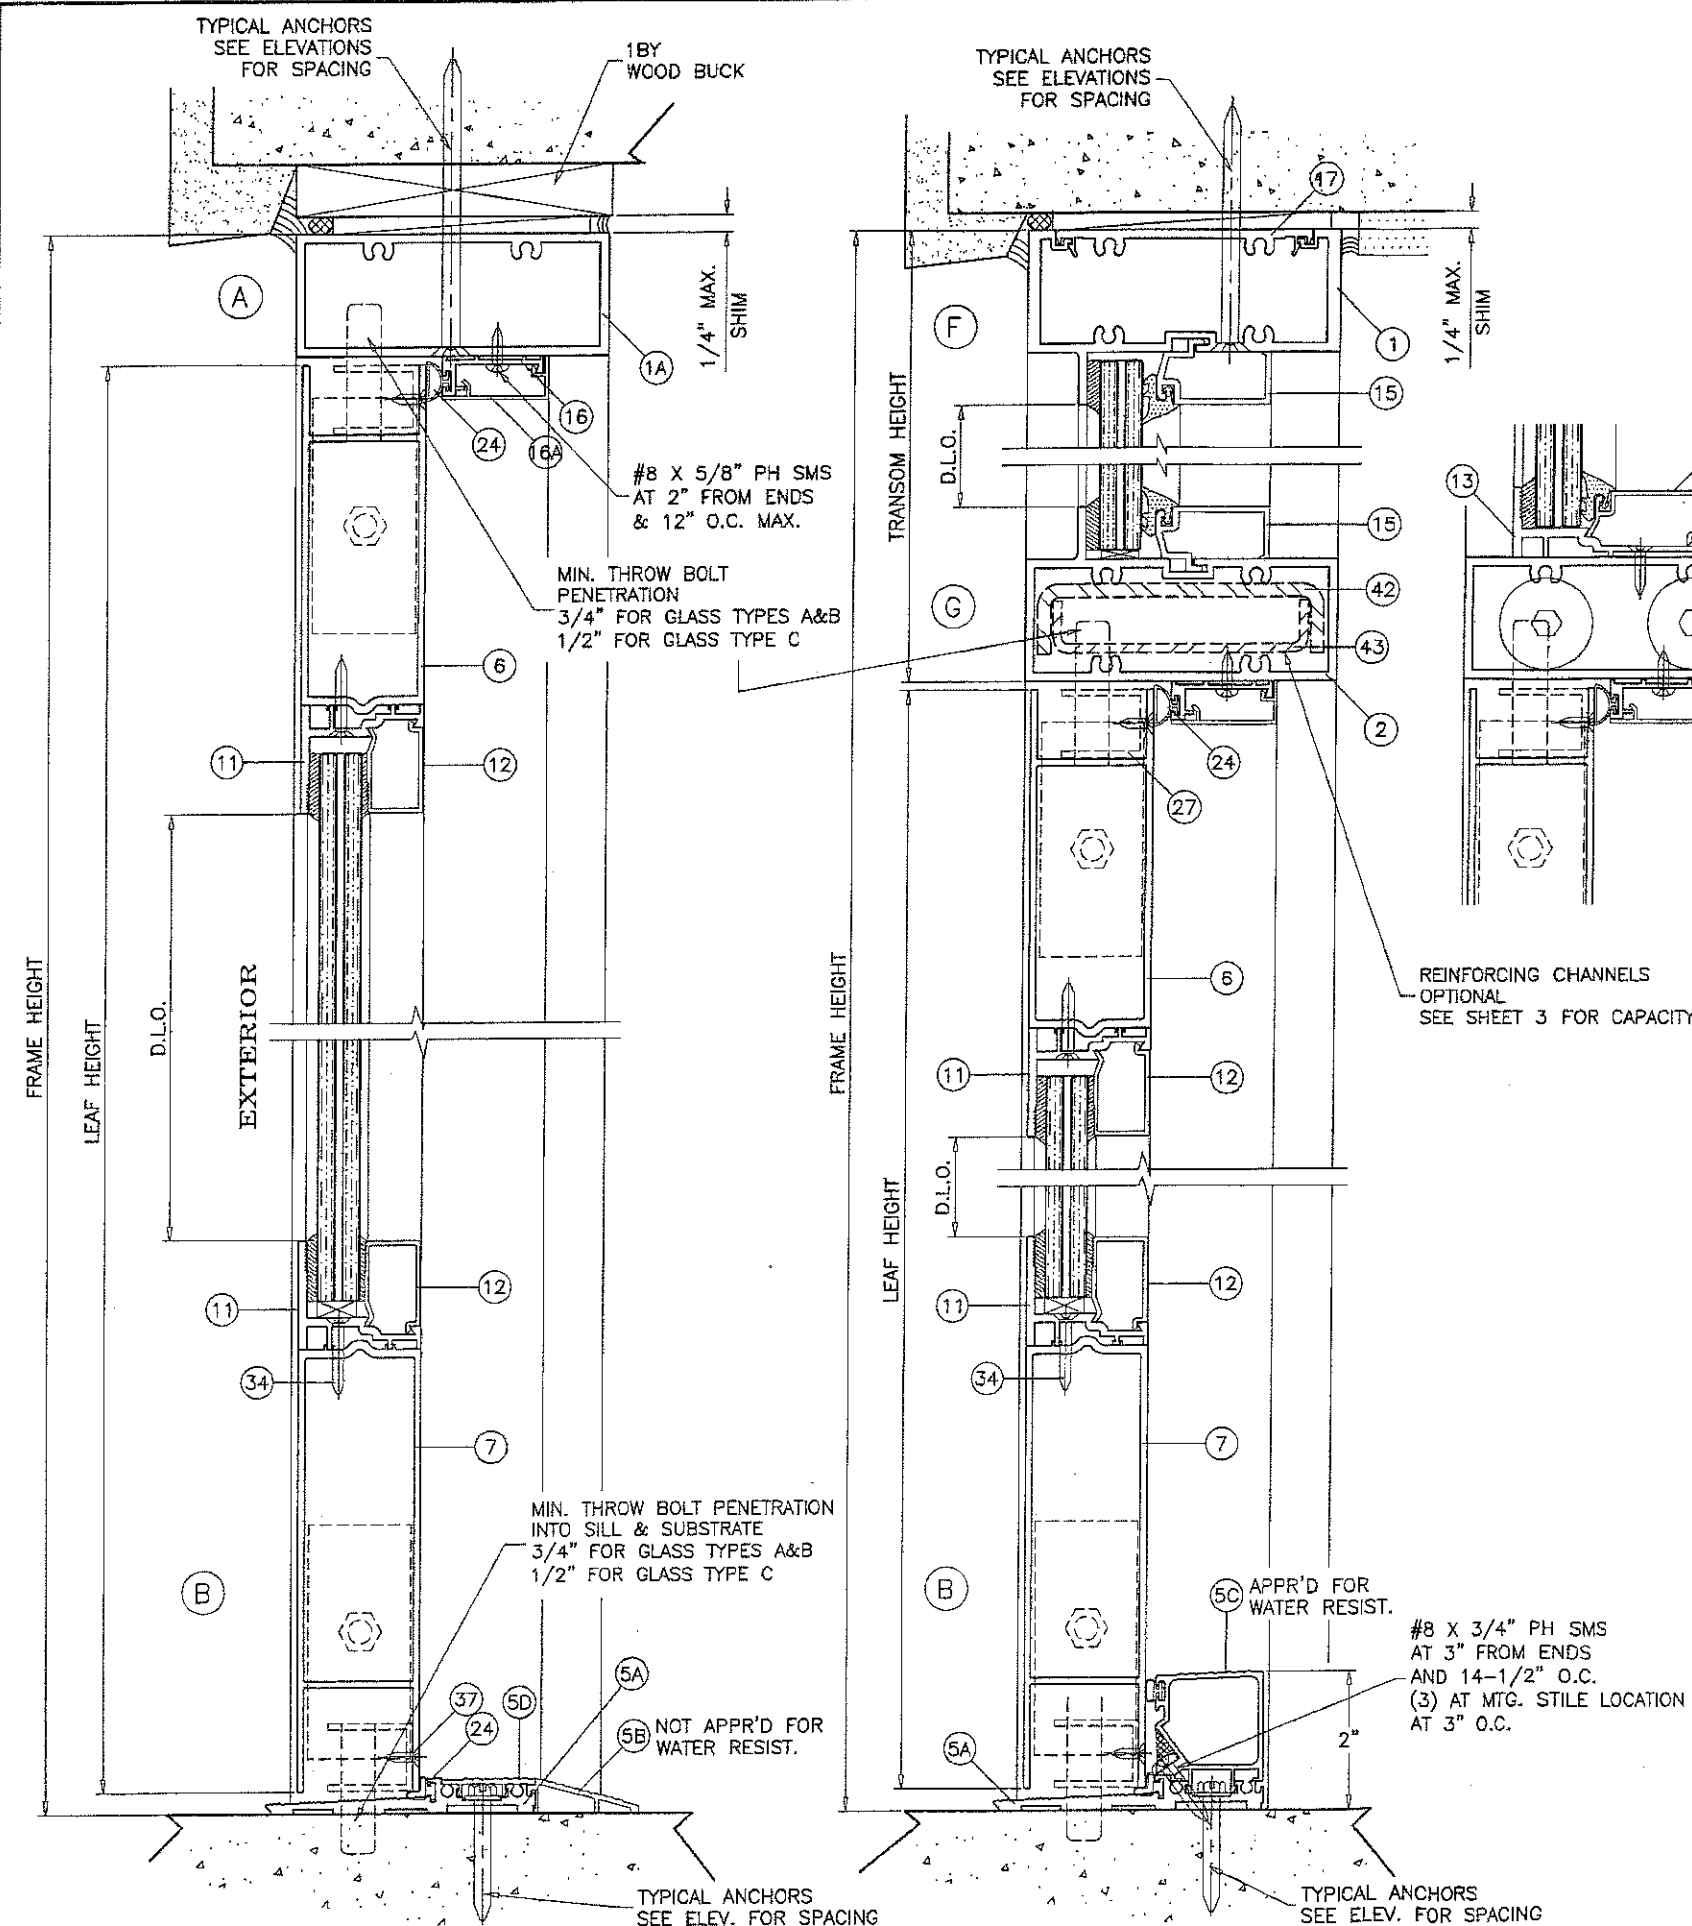

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY 'ALDORA ALUMINUM AND GLASS PRODUCTS' MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)
 THRU 1BY BUCKS INTO CONC. OR BLOCKS
 1-1/4" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
 1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)
 DIRECTLY INTO CONCRETE OR BLOCKS
 1-1/4" MIN. EMBED INTO CONC. OR BLOCKS (JAMBS)

TYPE 'B' - 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 DIRECTLY INTO CONCRETE
 1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)

TYPE 'C' - #14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS OR
 INTO METAL STRUCTURES (HEAD/JAMBS)
 (3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

MIN. CL TO CL SPACING (OR AS SHOWN)

INTO CONCRETE AND MASONRY = 3" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 1" MIN.


WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
 CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 GROUT FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 NOA-No. 17-1106.01

Expiration Date 05/12/2022

By Miami-Dade Product Control

JAN 08 2010

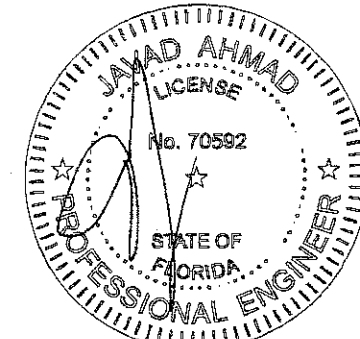

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978
 (C.A.N. 3538)

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR





Aldora Aluminum & Glass Products Inc.
 11500 MIRAMAR PARKWAY SUITE 300
 MIRAMAR, FL. 33025
 TEL. (305) 888-6288 FAX. (305) 888-6289

Revisions:


no	date	by	description
F	08.12.13		THRESHOLD DETAIL REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		REV. PER PER COMMENTS
I	09.05.17		REV. PER PER COMMENTS
J	01.05.18		NO CHANGE THIS SHEET

date: 10-25-04
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:


drawing no.
W04-91
 sheet 7 of 11

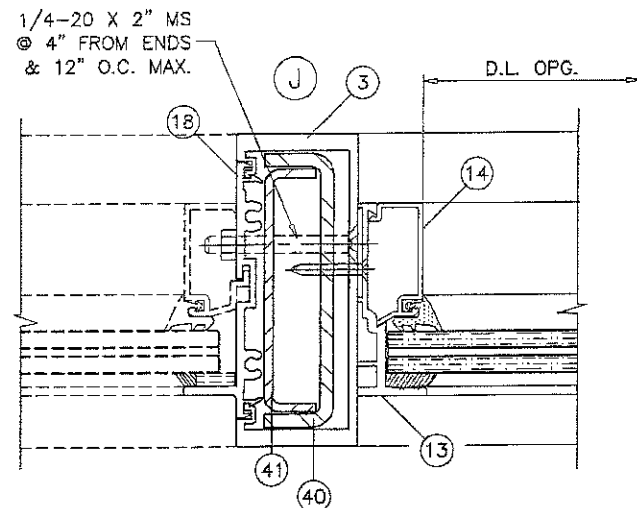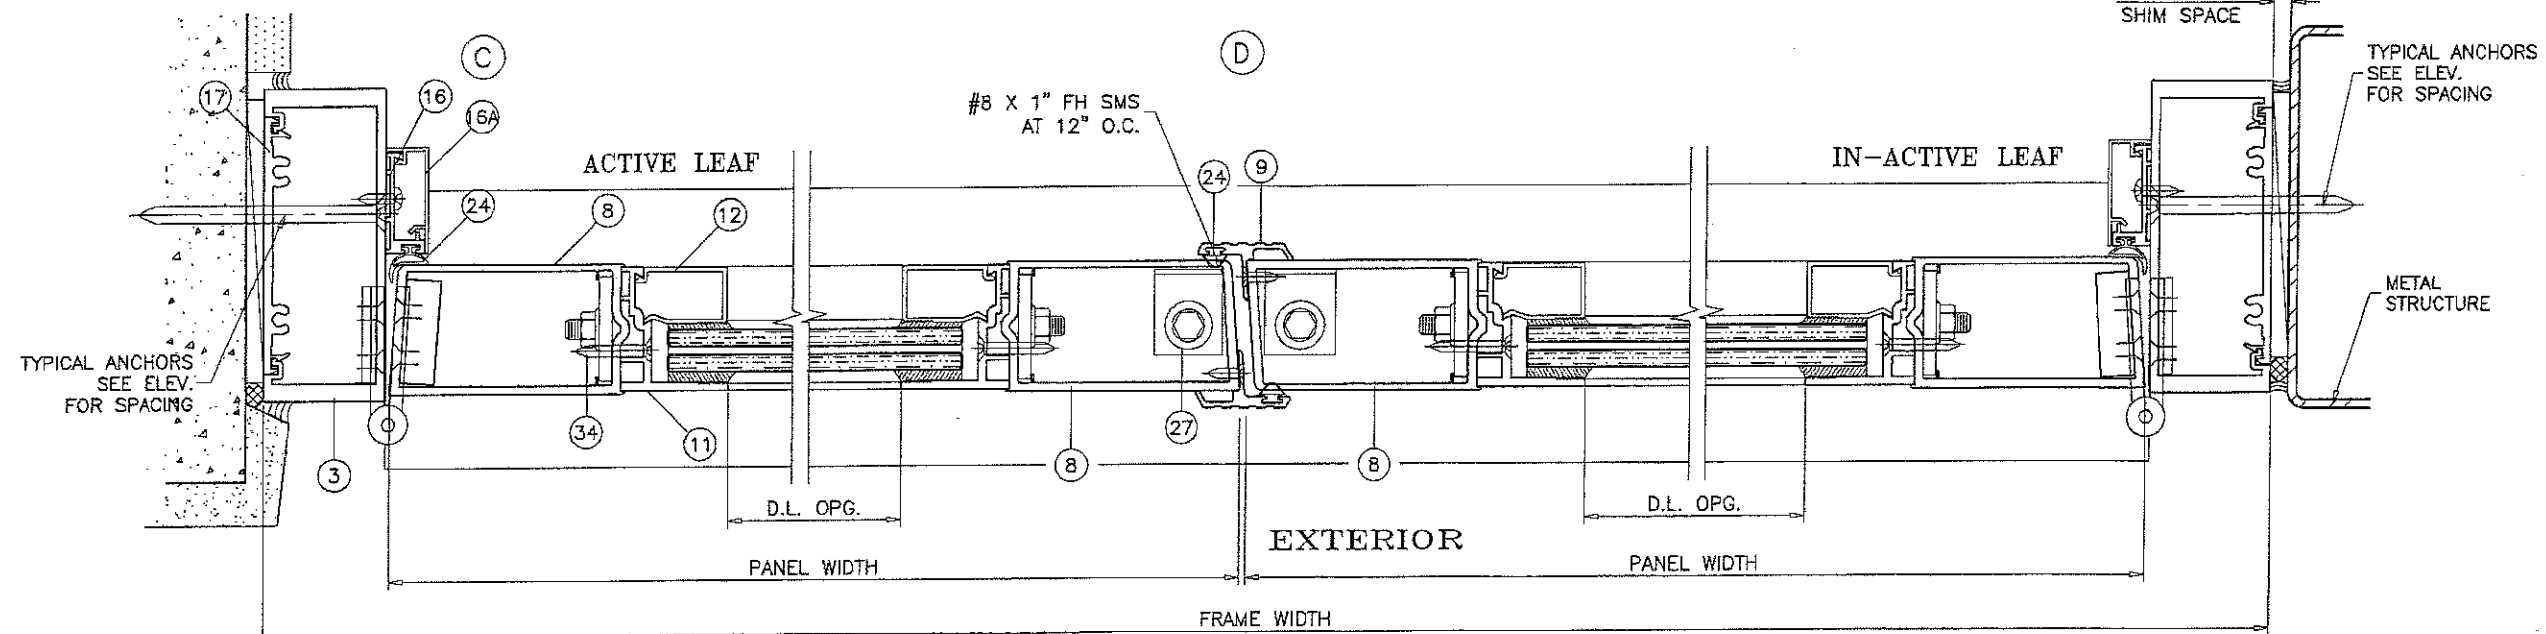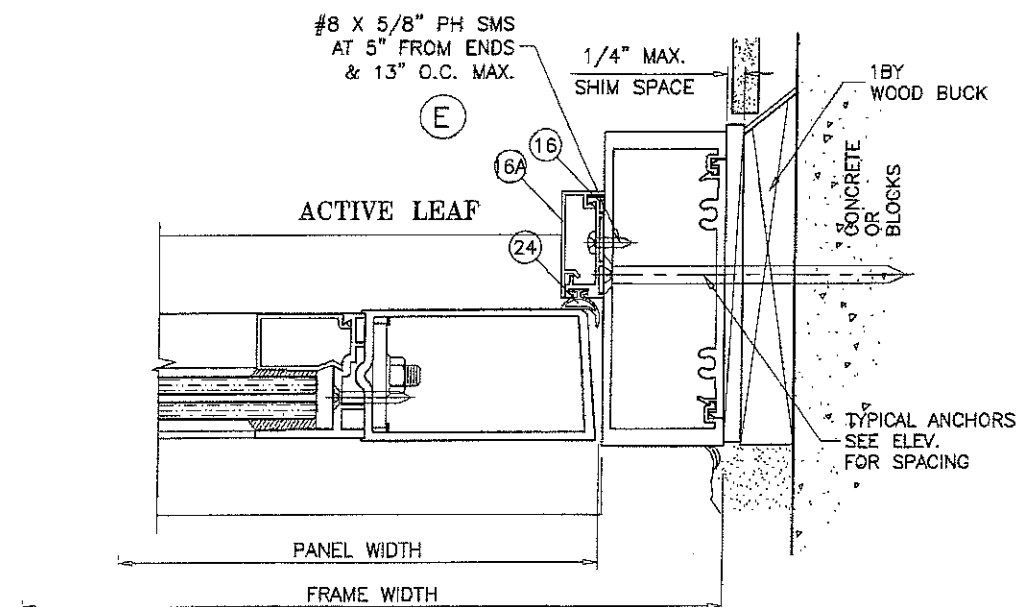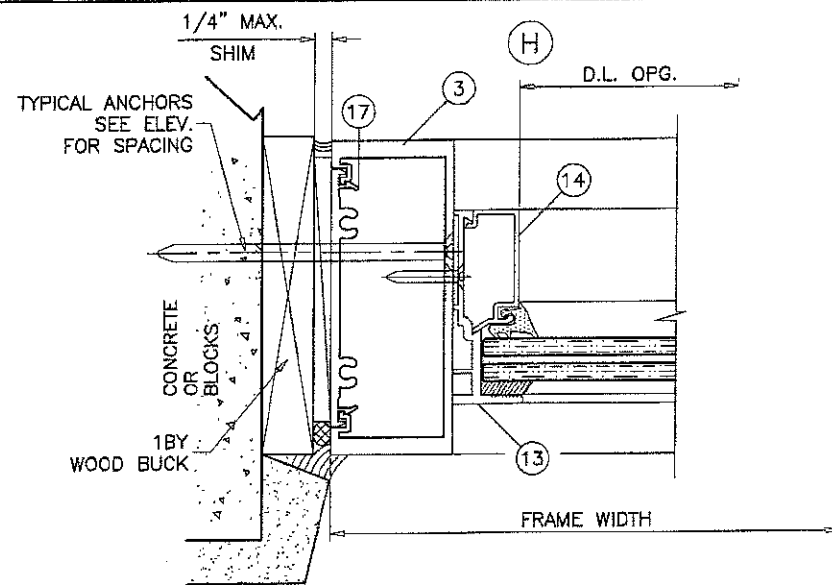

MIAMI-DADE COUNTY APPROVED
LARGE MISSILE IMPACT RESISTANT SM-175
STOREFRONT SYSTEM, SEE SEPARATE
'ALDORA ALUM & GLASS PRODUCTS'
NOA FOR DOOR MULLION CAPACITY

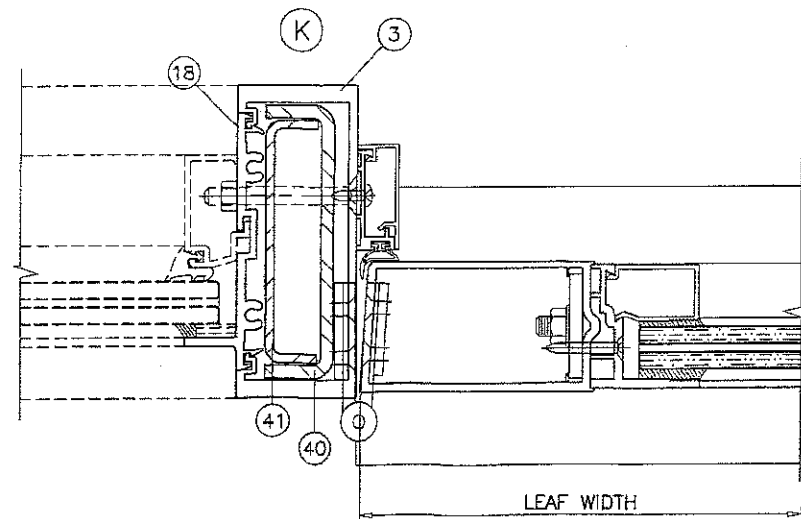

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 17-1106.01
Expiration Date 05/12/2022
By 
Miami-Dade Product Control

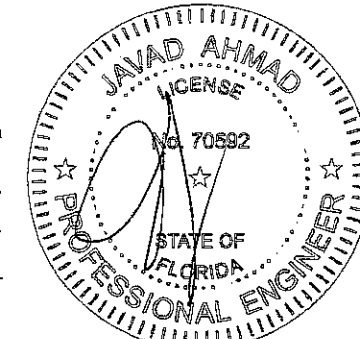





AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
(C.A.N. 3538)

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL (305) 888-6288 FAX (305) 888-6289

no	date	by	description
F	08.12.13		MANUF. NAME REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		REV. PER RER COMMENTS
I	09.05.17		REV. PER RER COMMENTS
J	01.05.18		NO CHANGE THIS SHEET


date: 10-25-04
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no.
W04-91
sheet 8 of 11

JAN 08 2019

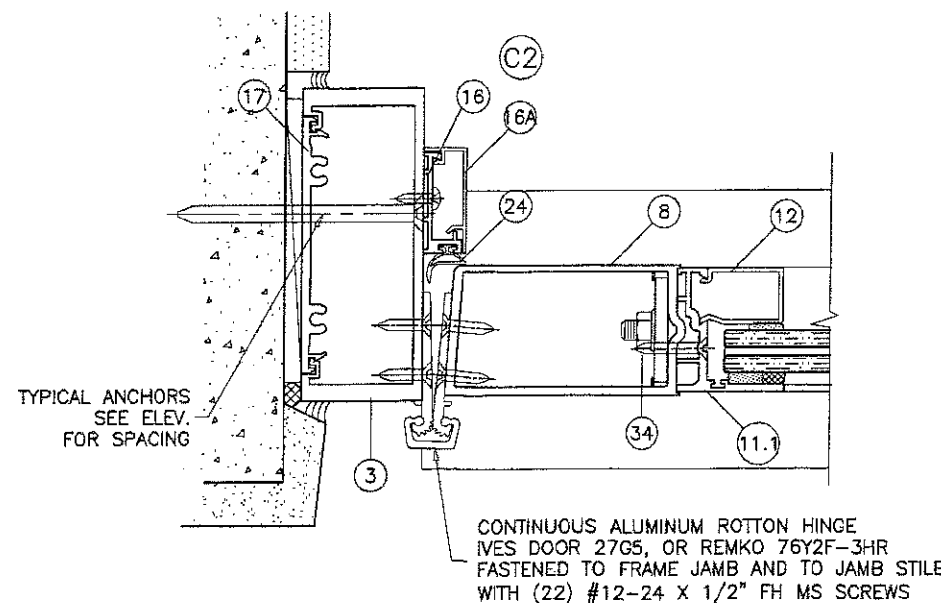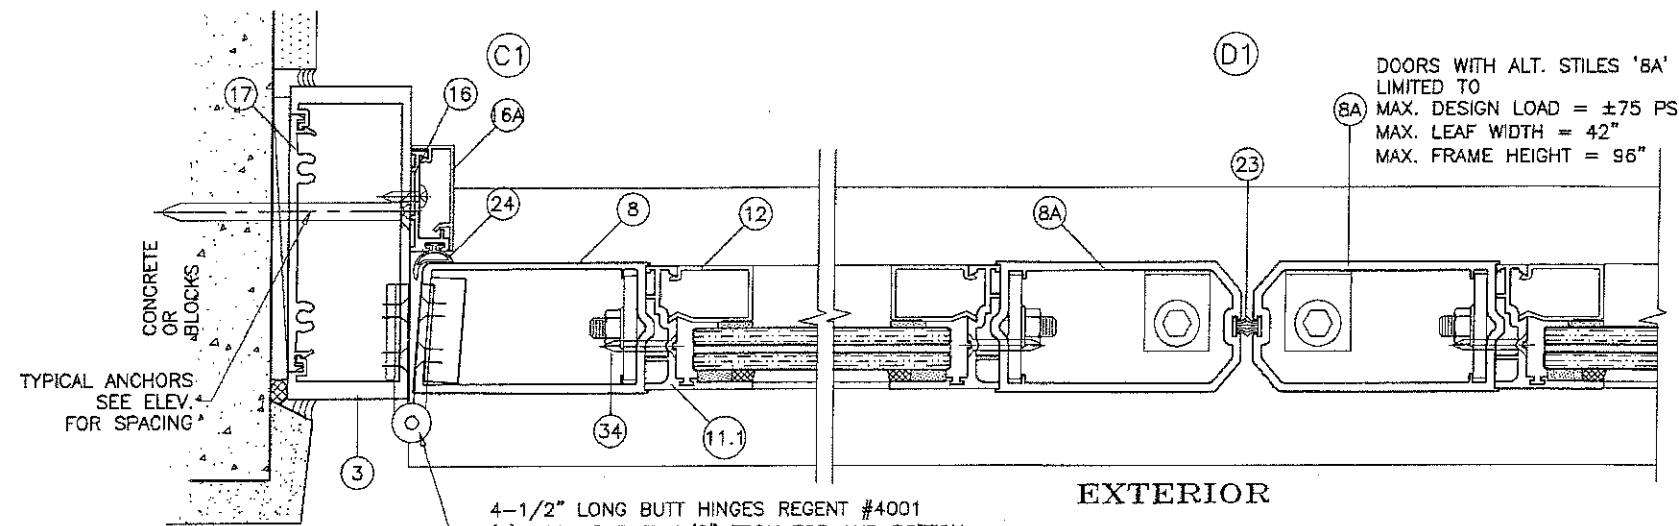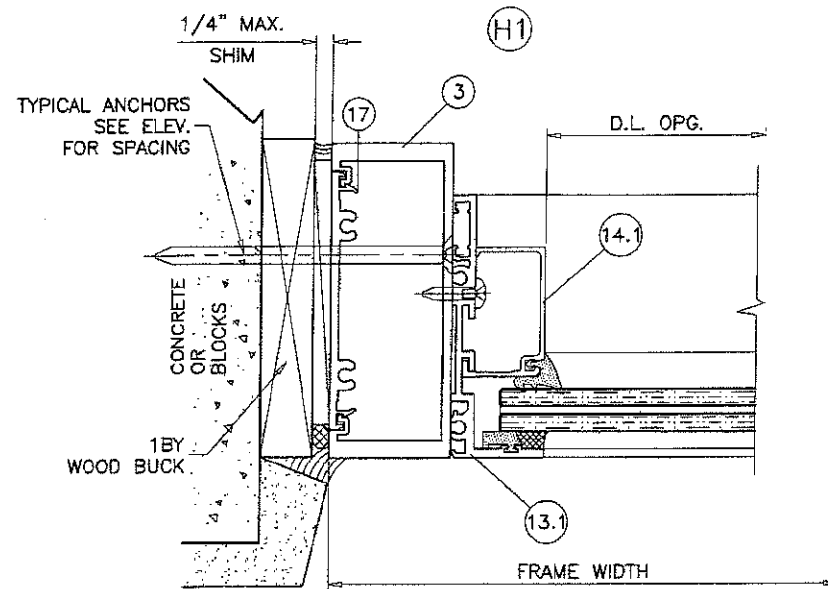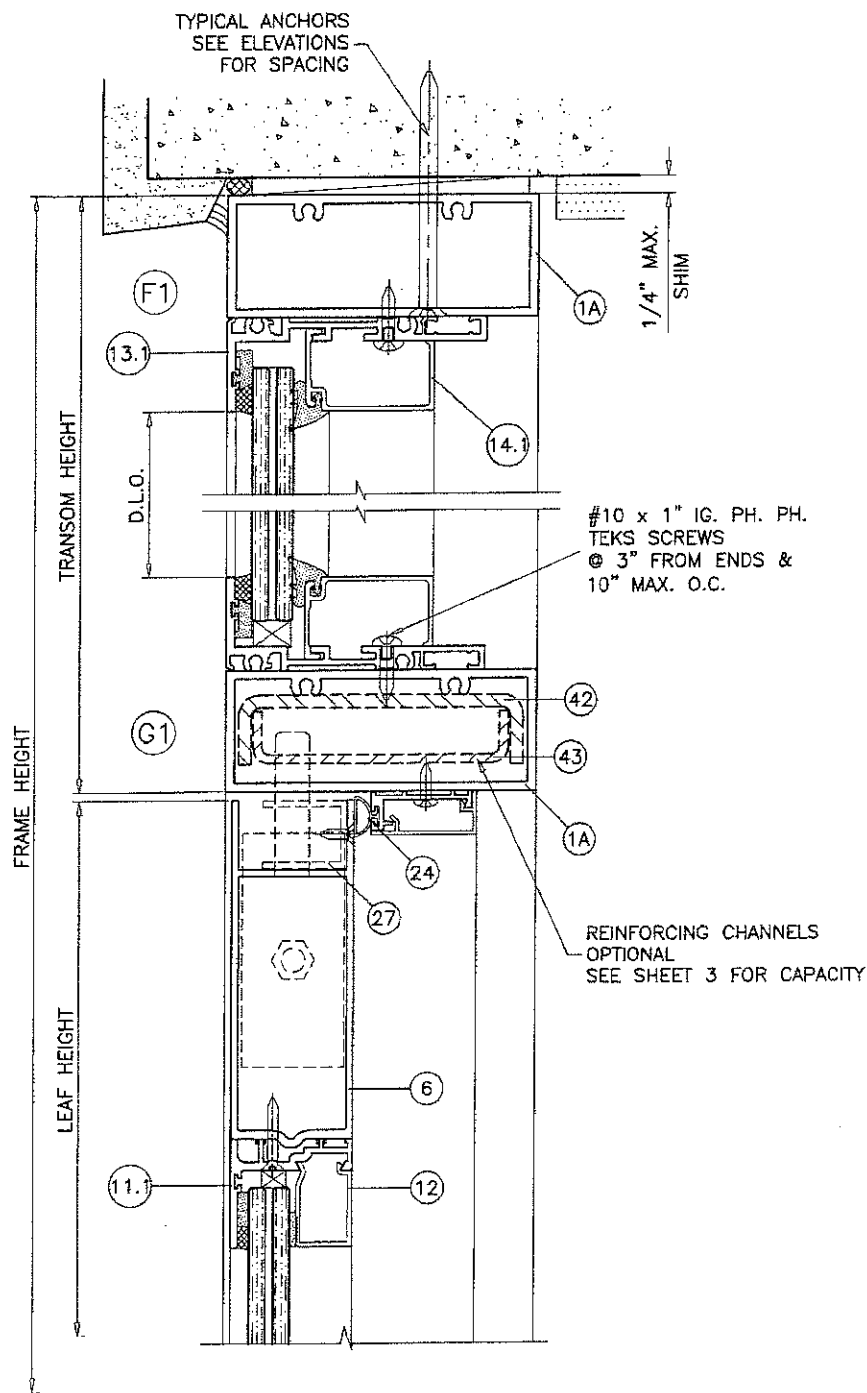

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**
Expiration Date **05/12/2022**
By **Miami-Dade Product Control**

JAN 08 2018

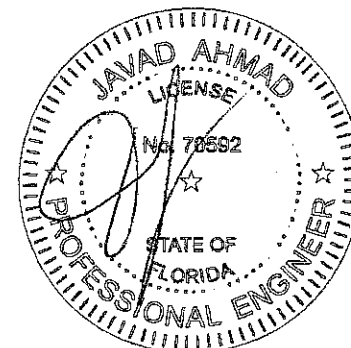


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-91SM


SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

no	date	by	description
1	11.11.17	REV. PER RER COMMENTS	
2	09.05.17	REV. PER RER COMMENTS	
3	01.05.18	REV. PER RER COMMENTS	


date: 10-25-04
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no. **W04-91**
sheet 8.1 of 11

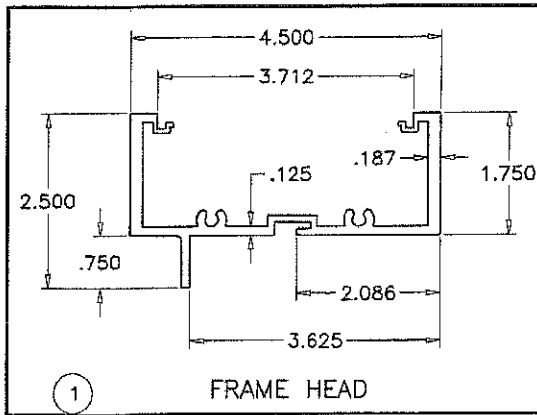


FRAME HEAD

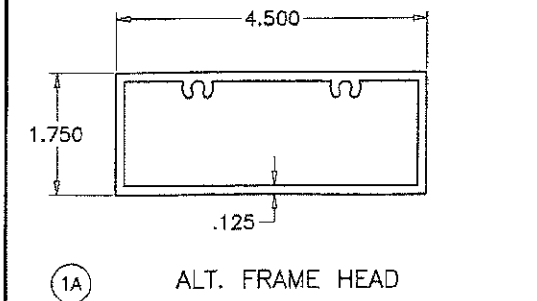


ALT. FRAME HEAD

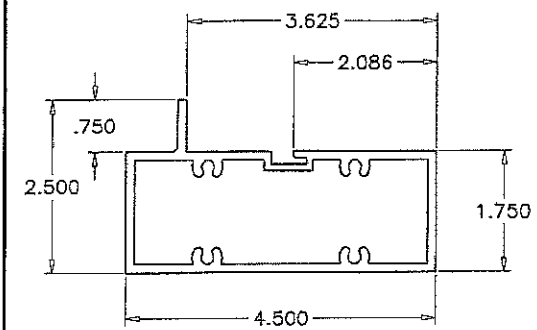


FRAME TRANSOM

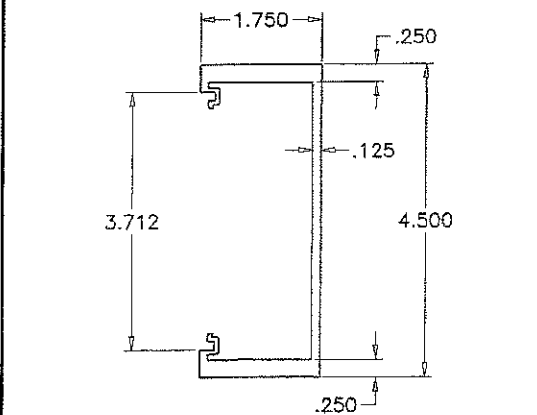


FRAME JAMB

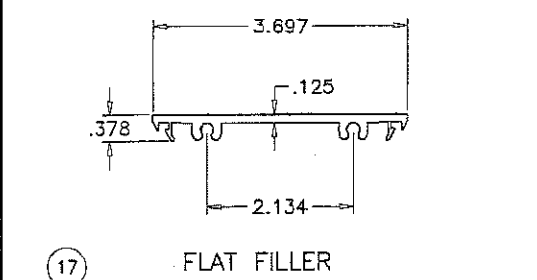


FLAT FILLER

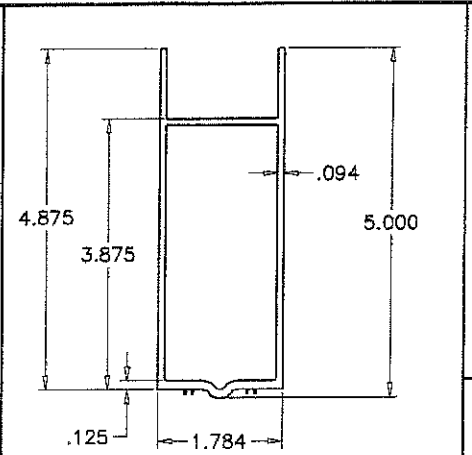


TOP RAIL

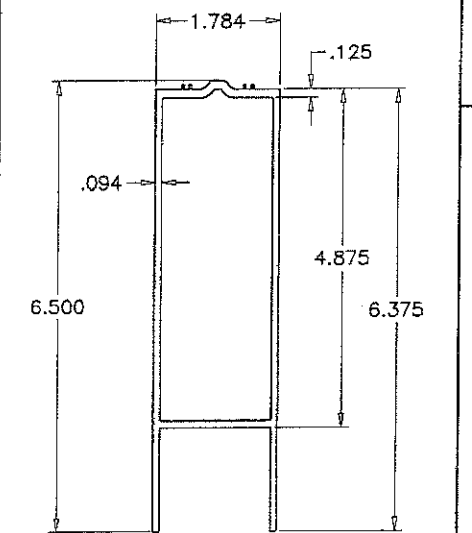


BOTTOM RAIL

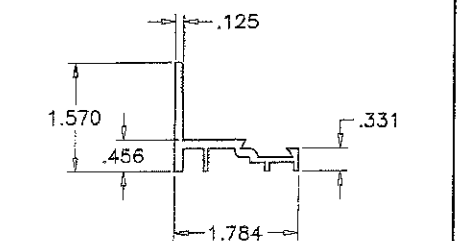


EXTERIOR GLASS STOP (DOOR)

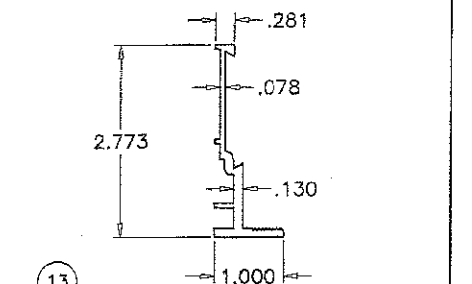


EXTERIOR GLASS STOP (TRANSOM)

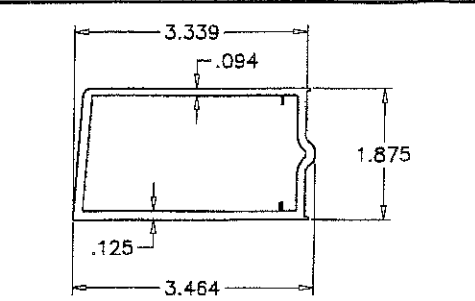


DOOR STILE

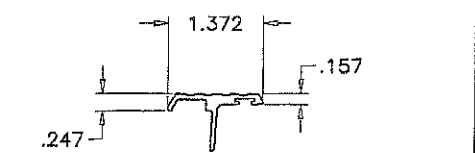


ASTRAGAL STILE

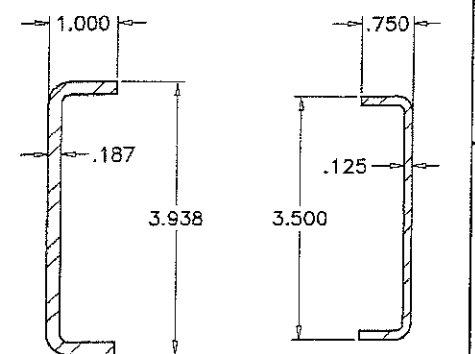


REINFORCING CHANNELS

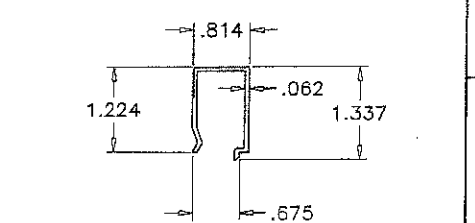


INTERIOR GLASS STOP (DOOR)

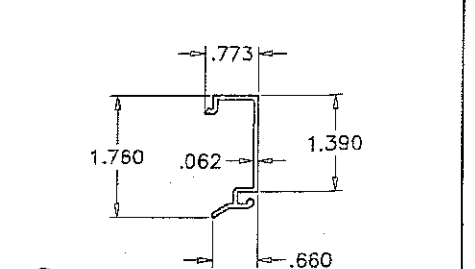


INTERIOR GLASS STOP (TRANSOM)

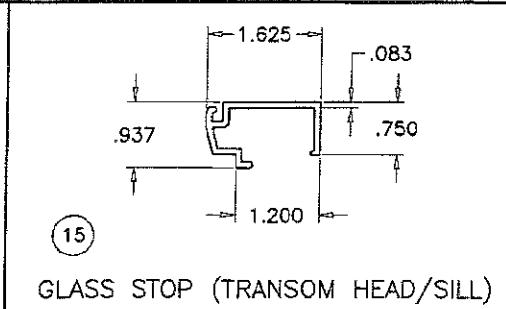



GLASS STOP (TRANSOM HEAD/SILL)

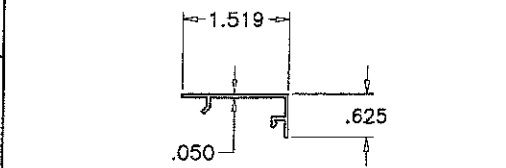


DOOR STOP COVER

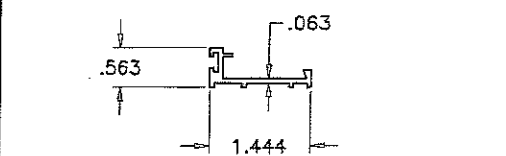


DOOR STOP

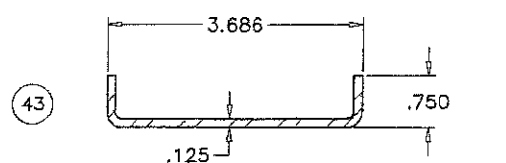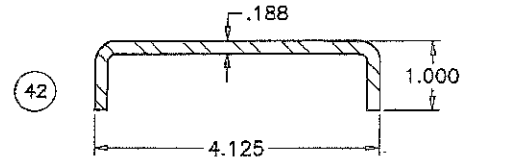


REINFORCING CHANNELS

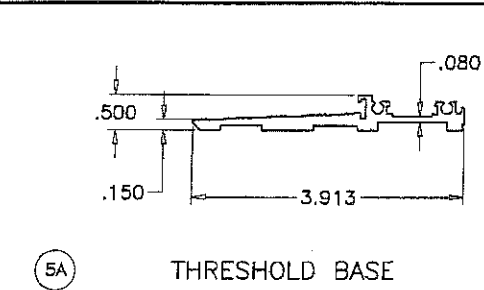


THRESHOLD BASE

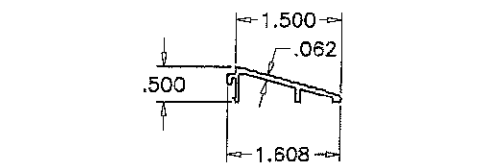

THRESHOLD RAMP ADAPTER

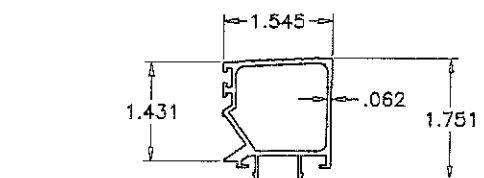

HI-RISE THRESHOLD COVER

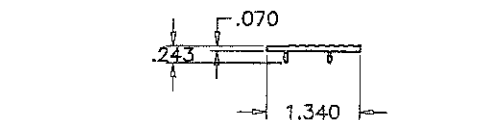


ADA THRESHOLD COVER

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**

Expiration Date **05/12/2022**

By *[Signature]*
Miami-Dade Product Control

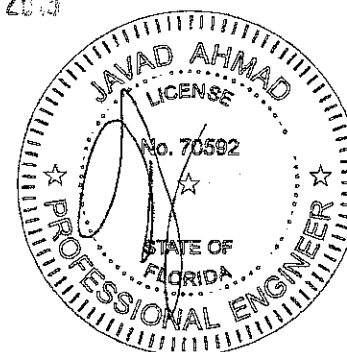

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
C.A.N. 3538
COMP-ANL\W04-91SM

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL (305) 888-6288 FAX (305) 888-6289

no	date	by	description
F	08.12.13		THRESHOLD REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		REV. PER RER COMMENTS
I	08.05.17		NO CHANGE THIS SHEET
J	01.05.18		NO CHANGE THIS SHEET

date: 10-25-04
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W04-91


sheet 9 of 11

JAN 08 2019


ITEM #	PART #	SMIS EXT. #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	5806	SMI-001	1	FRAME HEAD	6063-T6	-
1A	SMM-006	SMI-006	1	ALT. FRAME HEAD	6063-T6	-
2	5710	SMI-018	AS REQD.	FRAME TRANSOM	6063-T6	-
3	SMM-6007	SMI-005	2	FRAME JAMB	6063-T6	-
4	-	SMI-046	AS REQD.	MID-RAIL	6063-T6	OPTIONAL
4A	-	SMI-105	2	MID-RAIL CORNER CLIP	6005-T5	-
5A	-	SMI-036	1	THRESHOLD BASE	6063-T6	-
5B	-	SMI-037	1	THRESHOLD RAMP ADAPTER	6063-T5	-
5C	-	SMI-066	1	HI-RISE THRESHOLD COVER	6063-T5	-
5D	-	SMI-038	1	ADA THRESHOLD COVER	6063-T5	-
6	SMM-5984	SMI-012	1/ LEAF	TOP RAIL	6063-T6	-
7	SMM-5987	SMI-013	1/ LEAF	BOTTOM RAIL	6063-T6	-
8	SMM-5986	SMI-011	2/ LEAF	DOOR STILE	6063-T6	-
8A	-	SMI-009	2/ LEAF	ALT. DOOR STILE	6063-T6	-
9	SMI-030	SMI-030	1/ LEAF	ASTRAGAL	6063-T5	-
11	SMM-5981	SMI-007	4/ LEAF	EXTERIOR GLASS STOP (DOOR)	6063-T5	-
11.1	-	SMI-096	4/ LEAF	EXTERIOR GLASS STOP (DOOR)	6063-T5	-
12	SMM-5982	SMI-008	4/ LEAF	INTERIOR GLASS STOP (DOOR)	6063-T5	-
13	SMM-003	SMI-016	-	EXTERIOR GLASS STOP (TRANSOM JAMB)	-	-
13.1	SMI-PW001	-	-	TRANSOM ADAPTER	-	-
14	SMM-004	SMI-017	-	INTERIOR GLASS STOP (TRANSOM JAMB)	-	-
14.1	SMI-092	-	-	INTERIOR GLASS STOP (TRANSOM)	-	-
15	SMM-5712	SMI-002	2/ LITE	GLASS STOP (TRANSOM HEAD/SILL)	-	-
16	SMM-002	SMI-014	3/ DOOR	DOOR STOP	6063-T5	-
16A	SMM-001	SMI-015	3/ DOOR	DOOR STOP COVER	6063-T5	-
17	SMM-5807A	SMI-004	OPTIONAL	FLAT FILLER	6063-T6	-
18	SMI-003	-	AS REQD.	INTERMEDIATE SNAP-IN	6063-T5	-
19	H-63	SMI-G01	AS REQD.	WEDGE-IN GASKET	NEOPRENE	DUROMETER 68 SHORE A
20	-	SMI-G12	AS REQD.	DOUBLE FACE FOAM TAPE (3/16" X 1/2")	VINYL FOAM	FRANK LOWE
21	-	SMI-G07	AS REQD.	GASKET (@ EXTERIOR)	SANTOPRENE	CENTRAL PLASTICS INC.
22	-	SMI-G11	AS REQD.	SINGLE FACE FOAM TAPE (1/8" X 1/2)	VINYL FOAM	FRANK LOWE
23	-	SMI-W01	AS REQD.	PILE W'STRIPPING	WOOL	ULTRAFAB
24	-	SMI-G03	AS REQD.	BULB W'STRIPPING	VINYL	DUROMETER 83 SHORE A
26	-	-	2/ LEAF	3/8" THREADED ROD WITH NUT	STEEL	-
27	-	-	2/ LEAF	FLUSH BOLT GUIDE	ST. STEEL	-
28	-	-	AS REQD.	PUSH BAR	-	-
29	-	-	AS REQD.	PULL HANDLE	-	-
30	-	-	2	THRESHOLD CLIP	ALUMINUM	2" X 2" X 1/8" X 7/8" LONG
31	-	-	4/ LEAF	SUPPORT PLATE (1-1/2" X 3-3/8" X 3/16")	ALUMINUM	-
33	#12 X 1-1/2"	-	AS REQD.	FRAME ASSEMBLY SCREWS	-	HEX H TEKS
34	#10 X 1"	-	AS REQD.	GLASS STOP FASTENERS, AT 3" FROM ENDS & 10" O.C.	-	FH SMS
35	#12 X 3/4"	-	AS REQD.	THRESHOLD CLIP SCREWS	-	FH SELF DRILLING
37	#10 X 5/16"	-	2/ GUIDE	GUIDE INSTALLATION SCREWS	-	FH MS
40	-	-	-	REINFORCING CHANNEL (DOOR MULL)	STEEL	1" X 3-15/16" X 1" X 3/16" THK.
41	-	-	-	REINFORCING CHANNEL (DOOR MULL)	STEEL	3/4" X 3-1/2" X 3/4" X 1/8" THK.
42	-	-	OPTIONAL	REINFORCING CHANNEL (TRANSOM)	STEEL	1" X 4-1/8" X 1" X 3/16" THK.
43	-	-	OPTIONAL	REINFORCING CHANNEL (TRANSOM)	STEEL	3/4" X 3-11/16" X 3/4" X 1/8" THK.
44	-	-	2/ LITE	SETTING BLOCKS AT 1/4 POINTS	EPDM	DUROMETER 80±5 SHORE A
45	-	-	2/ LITE	SETTING BLOCKS AT 1/4 POINTS (1/4"X3/8"X4" LONG)	EPDM	TREMCO, DUROMETER 80±5 SHORE A

SEALANTS:


ALL FRAME AND LEAF CORNERS AND INSTALLATION SCREWS
SEALED WITH SILICONE.

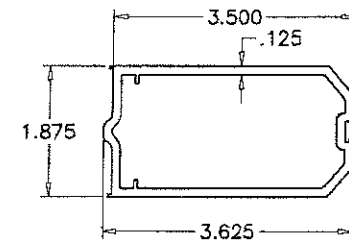


8A ALT. DOOR STILE

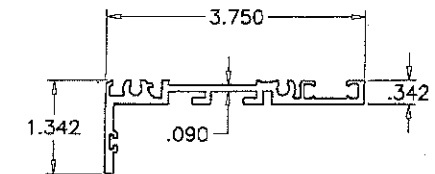

13.1 TRANSOM ADAPTER

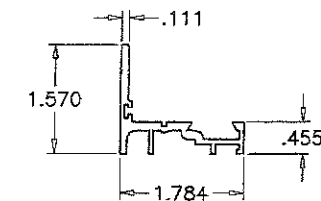

11.1 EXTERIOR GLASS STOP (DOOR)

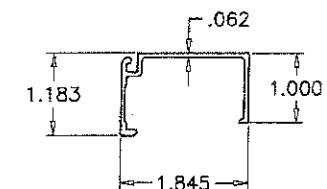


14.1 INTERIOR GLASS STOP (TRANSOM)

JAN 08 2018

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**

Expiration Date **05/12/2022**

By *[Signature]*
Miami-Dade Product Control

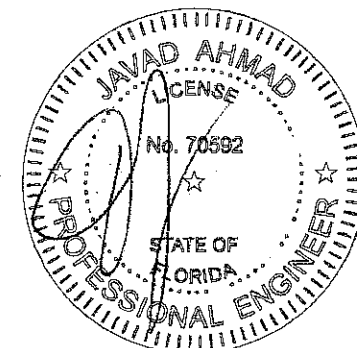

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
(C.A.N. 3538)

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Adora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

revisions:	no	date	by	description
	H	1.11.17		REV. PER RER COMMENTS
	I	09.05.17		REV. PER RER COMMENTS
	J	01.05.18		REV. PER RER COMMENTS

date: 10-25-04
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W04-91

sheet 9 of 11

afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W04-91SM

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

no.	date	by	Description
F	08.12.13		MANUF. NAME REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		REV. PER PER COMMENTS
I	09.05.17		NO CHANGE THIS SHEET
J	01.05.18		REV. PER PER COMMENTS

date: 10-25-04
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
W04-91
sheet 10 of 11

LOCK OPTIONS:

OPTION 1:

SINGLE LEAF DOORS:

ALL SINGLE LEAF DOORS TO BE FITTED WITH 3 POINT LOCK


DOUBLE LEAF DOORS:

ACTIVE LEAF:

THREE POINT LOCK SYSTEM WITH 5 PLY HOOK LOCK BOLT REGENT 2222, KEY OPERATED ON EXTERIOR AND THUMB-TURN ON INTERIOR, LOCATED AT 34" FROM BOTTOM OF PANEL

INACTIVE LEAF:

TWO POINT LOCK SYSTEM SULLIVAN CH 103 WITH THUMB TURN ON THE INTERIOR, LOCATED AT 34" FROM BOTTOM OF PANEL

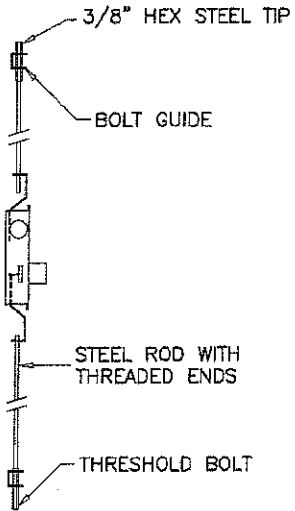

OPTION 2:

SINGLE LEAF DOORS:

ALL SINGLE LEAF DOORS TO BE FITTED WITH 3 POINT LOCK


DOUBLE LEAF DOORS:

ACTIVE LEAF:

THREE POINT LOCK SYSTEM WITH 4 PLY HOOK LOCK REGENT NO. 206-3P, KEY OPERATED ON EXTERIOR AND THUMB-TURN ON INTERIOR, LOCATED AT 36" FROM BOTTOM OF PANEL

INACTIVE LEAF:


TWO POINT LOCK SYSTEM SULLIVAN CH 103 WITH THUMB TURN ON THE INTERIOR, LOCATED AT 36" FROM BOTTOM OF PANEL

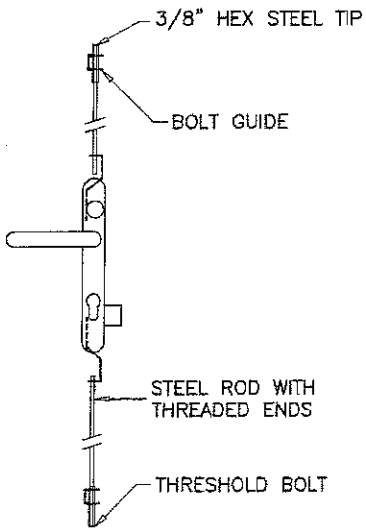

HINGE OPTIONS:


BUTT HINGES:

4-1/2 X 4" TWO PIECE STAINLESS STEEL BUTT HINGES AT 8" FROM TOP AND BOTTOM AND 26" O.C. MAX.

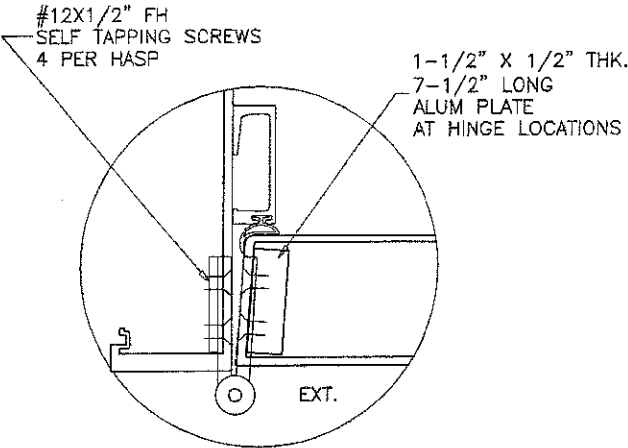

ROTON HINGE:

LIMIT MAX. DESIGN LOADS = ± 75.0 PSF
MAX. LEAF WIDTH = 42"
MAX. FRAME HEIGHT = 96"

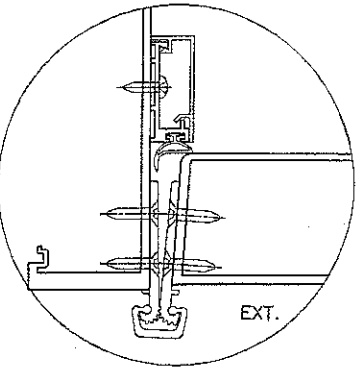



PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**

Expiration Date **05/12/2022**


By
Miami-Dade Product Control

JAN 08 2019

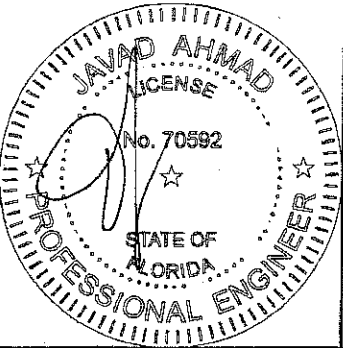


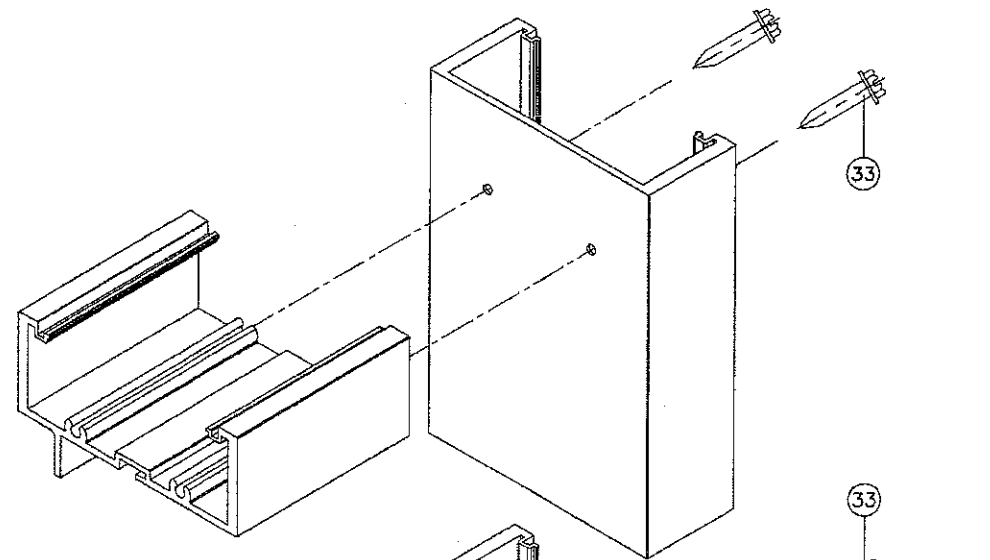


FRAME TOP CORNER

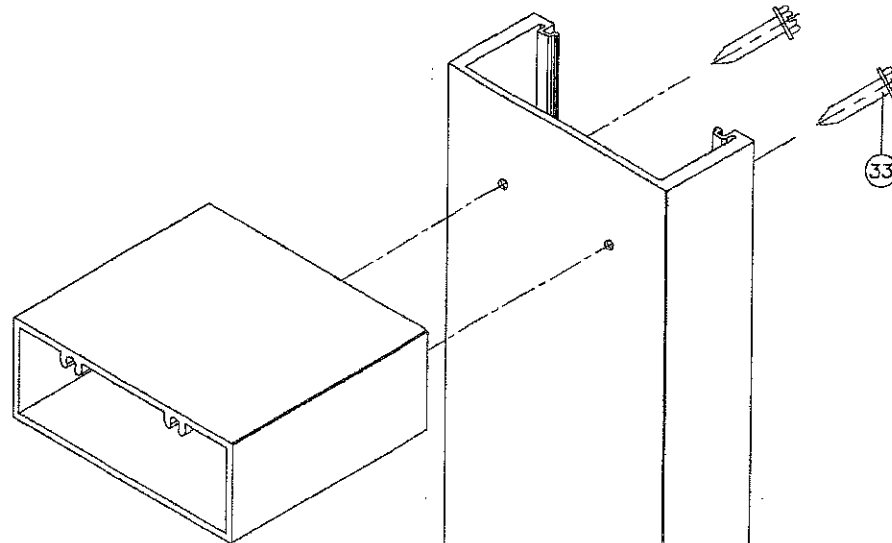


DOOR CORNER

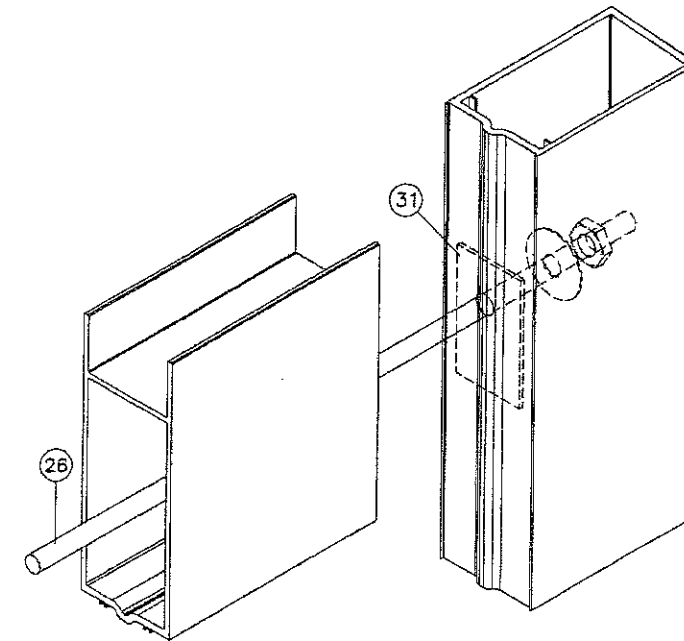

DOOR LEAF CORNER

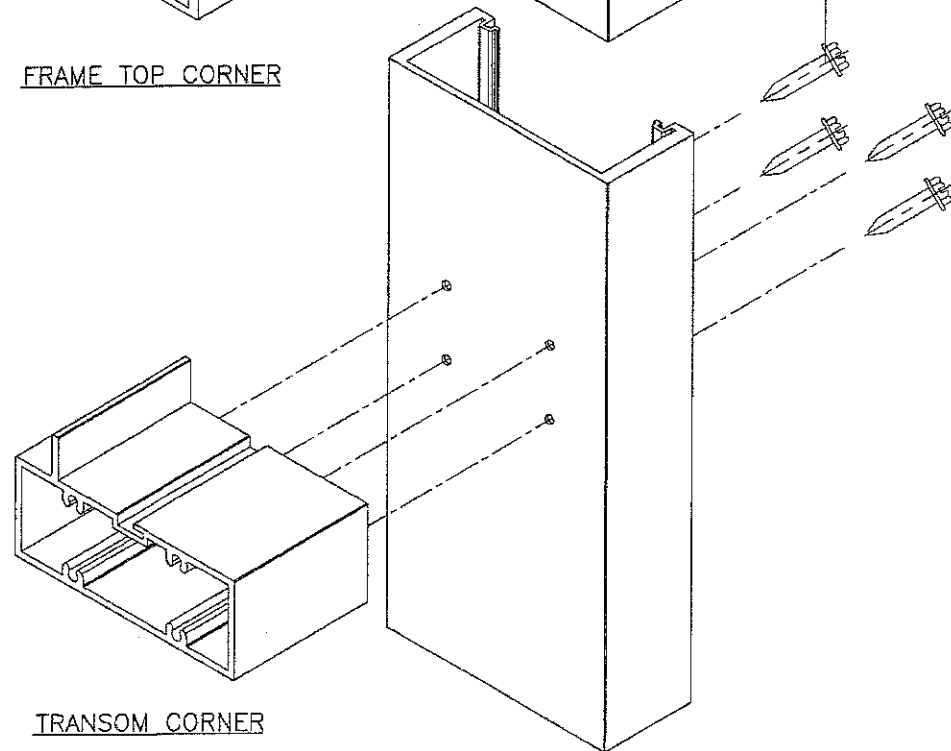


TRANSOM CORNER

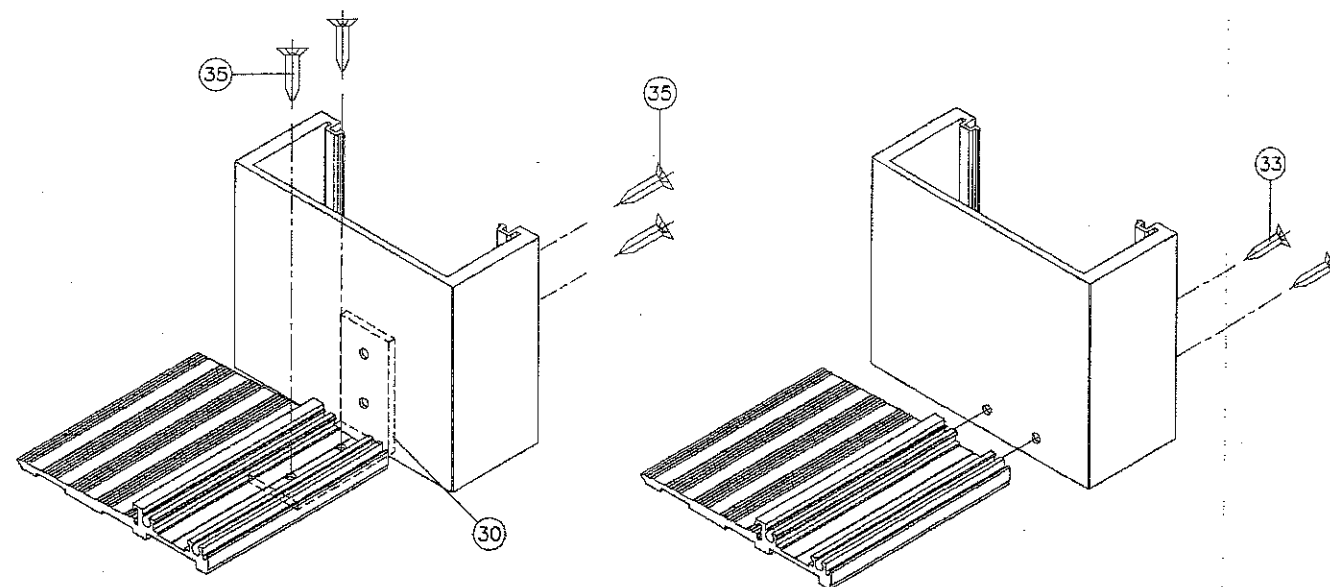

FRAME BOTTOM CORNER

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**
Expiration Date **05/12/2022**
By 
Miami-Dade Product Control

JAN 08 2018


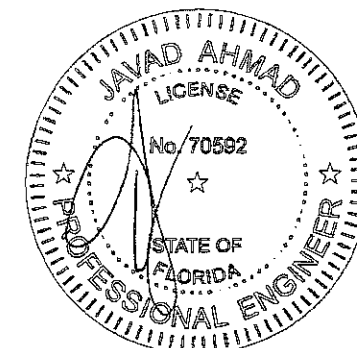


afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220 (C.A.N. 3538)
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-91SM

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289



no	date	by	description
F	08.12.13	MANUF. NAME REV.	
G	12.15.14	UPDATED TO 2014 FBC	
H	1.11.17	EDITORIAL CHANGES	
I	09.05.17	NO CHANGE THIS SHEET	
J	01.05.18	NO CHANGE THIS SHEET	

date: 10-25-04	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
drawing no.	W04-91		
sheet 11 of 11			

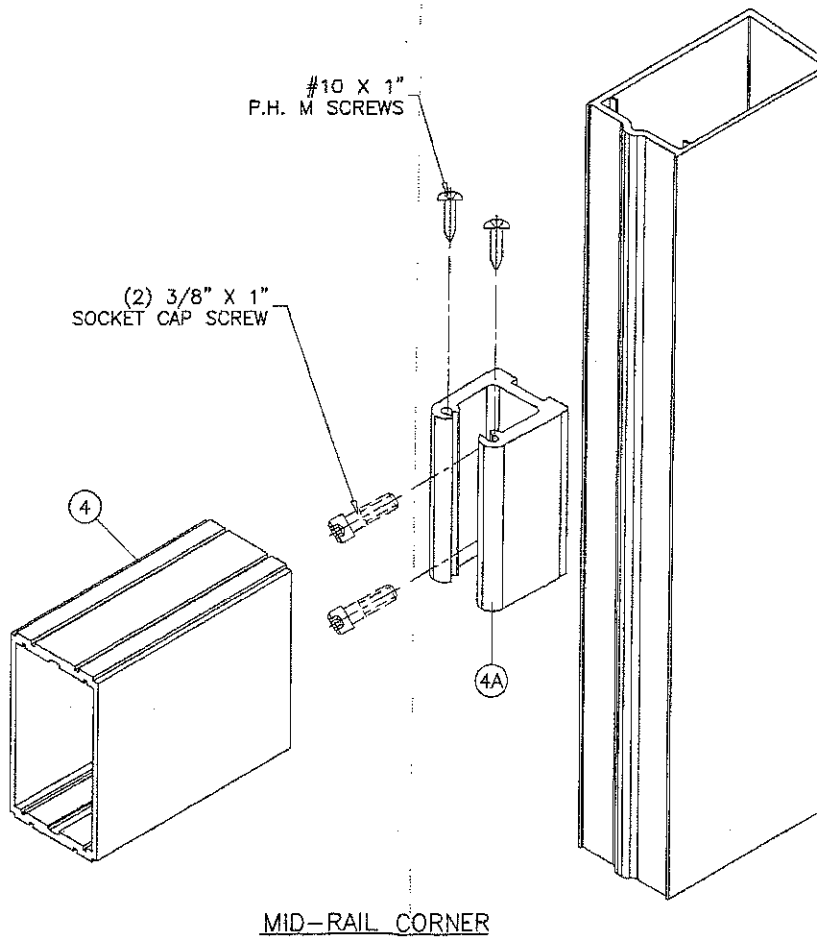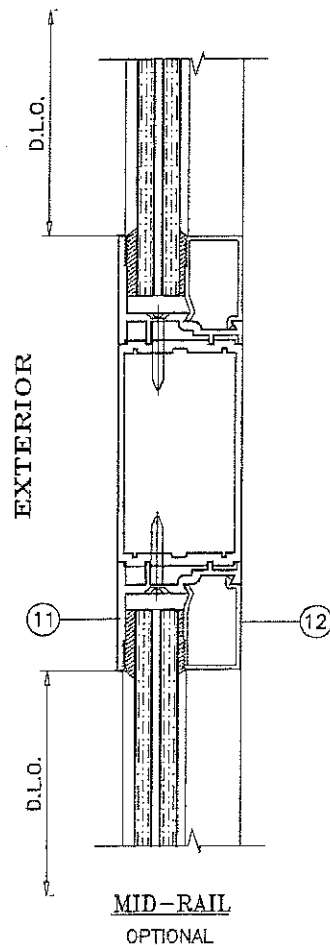


4A MID-RAIL CORNER CLIP

4 MID-RAIL

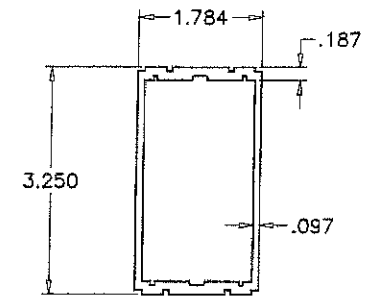

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **17-1106.01**
Expiration Date **05/12/2022**
By *[Signature]*
Miami-Dade Product Control

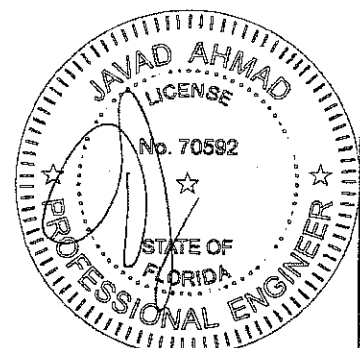

JAN 08 2018

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W04-91SM

SERIES K2LM ALUM OUT-SWING ENTRANCE DOOR
Aldora Aluminum & Glass Products Inc.
11500 MIRAMAR PARKWAY SUITE 300
MIRAMAR, FL. 33025
TEL. (305) 888-6288 FAX. (305) 888-6289

no	date	by	description
F	08.12.13		MANUF. NAME REV.
G	12.15.14		UPDATED TO 2014 FBC
H	1.11.17		EDITORIAL CHANGES
I	09.05.17		NO CHANGE THIS SHEET
J	01.05.18		REV. PER RER COMMENTS

date: 10-25-04
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no.
W04-91
sheet 11.1 of 11